

5440 Alder Drive
Houston, TX 77081

Phone: 800-836-7333
Fax: 713-664-6444
E-mail: emissions@ceconet.com

EMISSION TEST REPORT

REGULATION(S): 40 CFR 60 SUBPART JJJJ AND MDEQ PERMIT
POLLUTANT(S): CO, NOX, AND VOCs

ANR TRANSCANADA PIPELINE COMPANY BLUE LAKE 18 KALKASKA COUNTY, MI

PERMIT NUMBER: MI-ROP-B7198_2014A
FRS # / EPA REGISTRY ID: 110013860526
SOURCE CLASSIFICATION CODE (SCC): 20200254

RECEIVED
JAN 23 2018

EMISSION SOURCE: SPARK-IGNITED ENGINE
4-STROKE/2-STROKE: 4-STROKE
RICH/LEAN BURN: LEAN BURN
MAKE & MODEL: CATERPILLAR G3516
SOURCE NUMBER: BLGEN-C
UNIT NUMBER: C
SERIAL NUMBER: 3RC00643

AIR QUALITY DIVISION

TEST DATE: NOVEMBER 28, 2017

Pollutant	pounds / hour		g/BHP-hr		PASS/FAIL
	Permitted	Emitted	Permitted	Emitted	
CO	1.6	< 0.1	1.4	< 0.1	PASS
NOx	5.7	1.4	2	1	PASS
VOCs	0.9	< 0.1	0.55	< 0.01	PASS

Limits obtained from Permit MI-ROP-B7198_2014a.

The contents of this document relate only to the items tested. I certify under penalty of law that I believe the information provided in this document is true, accurate and complete. I am aware that there are significant civil and criminal penalties, including the possibility of fine or imprisonment or both, for submitting false, inaccurate or incomplete information.

CECO TEST LEADER:

HUY NGUYEN
SENIOR EMISSIONS TEST SPECIALIST
CECO TRAINING & TECHNICAL SERVICES
724-961-3584

This report may not be reproduced in full, or in part, without the written approval of ANR TransCanada Pipeline Company.

Revision History

Version	Revision Date	Comments
0	<i>original</i>	Original Version of Document.

Project Information

CECO Project No: 20171128-052-1

Contact Information

Facility Information

Facility ANR TransCanada Pipeline Company
Blue Lake 18
Kalkaska County, MI

Contact

Roy Cannon
700 Louisiana Street
Houston, TX 77028
832-320-5465
roy_cannon@transcanada.com

Testing Group Information

Contact

Huy Nguyen
CECO Training & Technical Services
5440 Alder Drive
Houston, TX 77081
724-961-3584
huy.nguyen@ceconet.com

Introduction

CECO Training & Technical Services, a division of Compressor Engineering Corporation, conducted source emission testing at ANR TransCanada Pipeline Company, Blue Lake 18 to fulfill the requirements of 40 CFR 60 Subpart JJJJ and MDEQ Permit. This report details the test purpose, objectives, testing procedures, sampling and analysis methodology, and results of the source testing conducted on November 28, 2017.

Process Description

The following source was tested:

- Unit Number C (Source ID BLGEN-C) SN 3RC00643 – one (1) Caterpillar G3516 natural gas-fired, 4-Stroke, Lean Burn internal combustion engine, rated to 1125 brake horsepower (BHP) at 1200 revolutions per minute (RPM). This source is equipped with Oxidation Catalyst w/AFR for emission control and drive a generator.

Test Purpose and Objectives

The purpose of this test was to fulfill the requirements of 40 CFR 60 Subpart JJJJ and MDEQ Permit. The objective of this test was to conduct the required three (3) 60-minute test runs to measure the applicable emission species at the maximum achievable load.

Results

Caterpillar B3516 Source ID:BLGEN-C Unit ID: C SN: 3RC00643		Test Run			Average
		1st	2nd	3rd	
Fuel					
HHV (BTU/SCF)	1020				
LHV (BTU/SCF)	923				
F-factor (DSCF/MMBTU)	8616				
Test Date & Time					
Date	11/28/2017	11/28/2017	11/28/2017		
Start Time	8:41 AM	9:50 AM	10:59 AM		
End Time	9:41 AM	10:50 AM	11:59 AM		
Interval (minutes)	60	60	60		60
Measured Concentrations (bias-corrected where applicable)					
O ₂ (%vd)	8.14	8.16	8.17		8.16
CO (ppmvd)	0.8	0.5	0.5		0.6
NO _x (ppmvd)	133.4	137.5	138.1		136.3
VOCs (ppmvd)	-198.8	-194.1	-198.4		-197.1
THC (ppmvd)	376.3	380.3	381.7		379.4
Operating Conditions					
Engine Horsepower (BHP)	718	712	712		714
Engine (Torque) Load (%)	63.7	63.2	63.2		63.4
Engine Speed (RPM)	1202	1202	1202		1202
Fuel Flow Rate (SCFH)	6177	6210	6153		6180
BSFC (BTU/BHP/hr), LHV	7937	8047	7974		7986
Fuel BTU Consumption (MMBTU/hr)	6.30	6.34	6.28		6.30
Exhaust Flow Rate (SCFH)	88921	89541	88794		89085
Exhaust Flow Rate (SCFM)	1482.0	1492.4	1479.9		1484.8
Calculated Emissions					
CO	(lb/hr)	0.0052	0.0033	0.0032	0.0039
	(ton/year)	0.0226	0.0142	0.0141	0.0170
	(g/BHP-hr)	0.0033	0.0021	0.0021	0.0025
	(ppmvd at 15% O ₂)	0.3699	0.2316	0.2317	0.2777
NO _x	(lb/hr)	1.4156	1.4693	1.4634	1.4494
	(ton/year)	6.2004	6.4355	6.4097	6.3485
	(g/BHP-hr)	0.8940	0.9357	0.9320	0.9206
	(ppmvd at 15% O ₂)	61.6818	63.6774	64.0055	63.1216
VOCs	(lb/hr)	< 0.1000	< 0.1000	< 0.1000	< 0.1000
	(ton/year)	< 1.0000	< 1.0000	< 1.0000	< 1.0000
	(g/BHP-hr)	< 0.1000	< 0.1000	< 0.1000	< 0.1000
	(ppmvd at 15% O ₂)	< 1.0000	< 1.0000	< 1.0000	< 1.0000
THC	(lb/hr)	3.8276	3.8952	3.8770	3.8666
	(ton/year)	16.7648	17.0612	16.9811	16.9357
	(g/BHP-hr)	2.4173	2.4807	2.4690	2.4557
	(ppmvd at 15% O ₂)	173.9945	176.1201	176.9073	175.6740

Methodology and Sampling Procedures

Methodology

Parameter	Sampling Method
Oxygen (O ₂)	40 CFR 60, Appendix A, Method 3A
Oxides of Nitrogen (NO _x)	40 CFR 60, Appendix A, Method 7E
Carbon Monoxide (CO)	40 CFR 60, Appendix A, Method 10
Volumetric Exhaust Flow Rate	40 CFR 60, Appendix A, Method 19
Gas Dilution System	40 CFR 60, Appendix A, Method 205
Methane (CH ₄) & Ethane (C ₂ H ₆)	ASTM D6348
Total Hydrocarbons (THC)	40 CFR 60, Appendix A, Method 25A
Volatile Organic Compounds (VOCs)	40 CFR 60, Appendix A, Method 25A & ASTM F6348 Subtraction

VOCs via Method 25A

The following gasses were individually quantified on the Fourier Transfer Infrared Spectroscopy (FTIR) analyzer and summed on a propane basis to calculate total hydrocarbons (THC). Methane response factors (based on carbon number) are listed after each compound. Methane and Ethane were subtracted from the total hydrocarbons to calculate Non-methane/Non-ethane (NM/NE) VOCs, reported as propane. Formaldehyde was specifically excluded per 60.4244 (f).

Methane (RF 1)	Ethylene (RF 2)	Propane (RF 3)	Butane (RF 4)	Acetaldehyde (RF 2)
Ethane (RF 2)	Acetylene (RF 2)	Propylene (RF 3)	Methanol (RF 1)	Formic Acid (RF 1)

Horsepower and Fuel Flow Determination

For this test, horsepower was calculated from the load percentage displayed on the engine panel and fuel flow was obtained from a fuel flow meter. The Engine Torque Load averaged 63.4% for the test. This was the highest achievable load based on the operating parameters during the test, which are included in Appendix A.

Sampling System

Compressor Engineering Corporation designed and assembled a versatile, emission testing unit (ETU), which houses all analyzers, computers and auxiliary equipment. Effluent stack gas enters the ETU through a heated Teflon sample line. A heated head pump with a Teflon diaphragm pulls the sample into the trailer, through a heated filter, and sends the wet gas directly to the inlet of the FTIR. The heated pump, sample lines, and filter have their temperatures maintained at approximately 191 °C. The FTIR analyzer gas cell and gas inlet temperatures are also maintained at approximately 191 °C. The sample is routed from the exit of the FTIR through a heated Teflon line to a gas conditioner for moisture removal. The dry gas exiting the gas conditioner is routed to a gas distribution panel which sends a portion of the gas to the paramagnetic oxygen analyzer.

The MKS Instruments MultiGas 2030 FTIR analyzer is used to determine the CO, NO_x, and VOCs emission concentrations. The FTIR serves as the instrument for Methods 7E and 10, and meets the requirements of Section 13 of Method 7E. All measured concentrations are corrected to a dry basis via the MKS MG2000 operating software. The FTIR analyzer is configured with

a fixed optical pathlength of 5.11 meters. The measured concentrations are collected at a 0.5 cm^{-1} resolution. Each spectrum is derived from the co-addition of 60 scans. Data is collected continuously during each test run. A new data point is generated every 60 seconds.

A software package (CECOTest) is used to collect and processes data. CECOTest continually logs data every 15 seconds from the oxygen analyzer and the FTIR during the 60 minute runs.

Refer to **FIGURE 1** for a schematic of the sampling system.

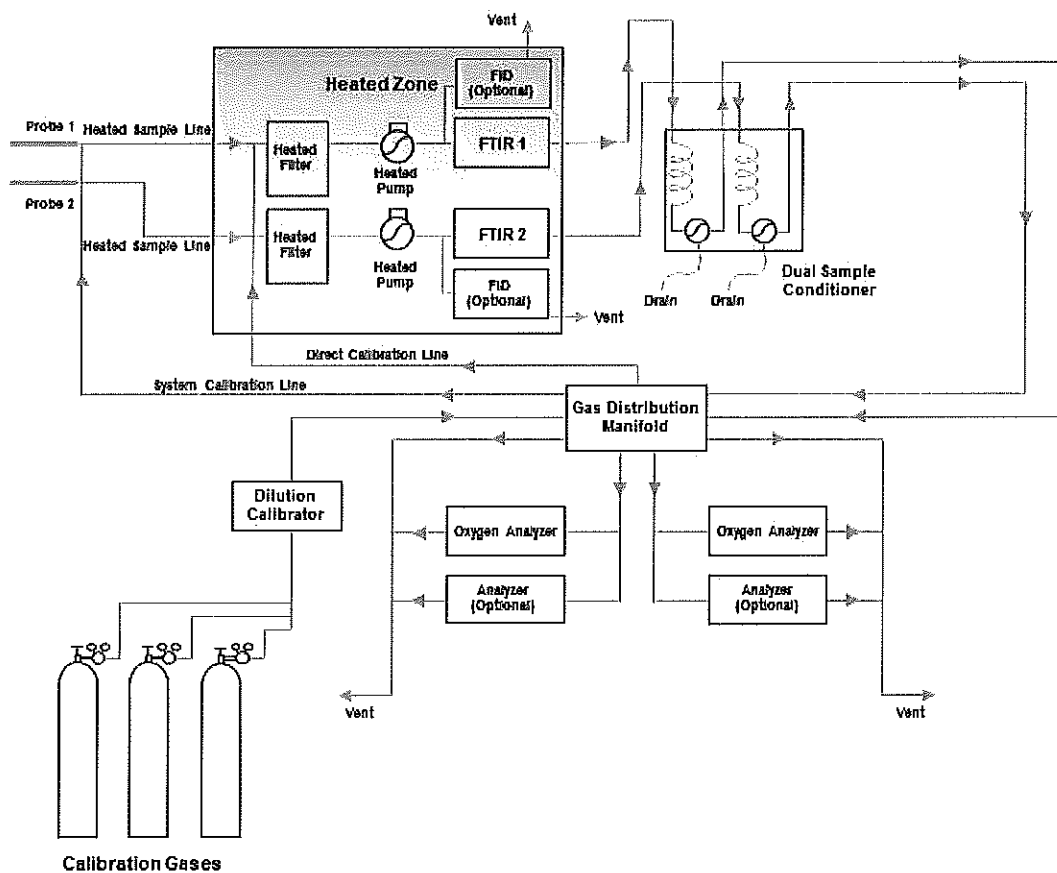


Figure 1: Sampling System Schematic

Instrument Specifications

Description:	Oxygen Analyzer
Manufacturer:	Servomex
Model:	1440C
Serial Number:	01440C1STO-2594
Technology Type:	Paramagnetic
Range:	0-25%
Repeatability:	+/- 0.1% O ₂
Response Time (90%):	Typically less than 10 sec
Linearity:	+/- 0.1% O ₂

Description:	FTIR Analyzer
Manufacturer:	MKS Instruments
Model:	2030
Serial Number:	017979534
Technology Type:	FTIR Spectrometry
Range:	between 10ppb and 100% fullscale
Spectral Resolution:	0.5-128 1/cm
Scan Speed:	1/sec @ 0.5 1/cm
Detector Type:	LN2-cooled MCT


Manufacturer:	Teledyne
Model:	T700
Serial Number:	70
Technology Type:	Mass Flow Controller
MFC's:	0LPM, 2LPM, and 200ccm
Flow Measurement Accuracy	+/-1.0% of Full Scale
Repeatability of Flow Control	+/-0.2% of full Scale
Linearity of Flow Measurement	+/-0.5% of Full Scale
Flow Range of Diluent Air	0 to 10 SLPM
Optional Ranges:	0 to 5 SLPM; 0 to 20 SLPM
Flow Range of Cylinder Gasses	0 to 100 cc/min
Optional Ranges:	0 to 50 cc/min; 0 to 200 cc/min
Zero Air Required:	10 SLPM @ 30 PSIG
Optional	20 SLPM @ 30 PSIG
CAL Gas Input Ports	4 (configurable)
Diluent Gas Input Ports	1
Response Time	60 Seconds (98%)

Description:	Flame Ionization Analyzer
Manufacturer:	J.U.M. Engineering
Model:	1440C
Serial Number:	serial number 8
Outputs:	0-10V, 4 - 20mA.
Detection Method:	Flame Ionization Detector.

Detection Limit:	1ppm CH4 at full scale.
Ranges:	0-10, 0-100, 0-1,000, 0-10,000, 0-100,000ppm.
Response Time:	0.2 sec.
Sample Flow Rate:	2.5 L/min.
Drift:	Span (24 hours): <1%. Zero (24 hours): <1%.
Linearity:	within 1% of full scale

Description of Sampling Location

Physical Duct Parameters

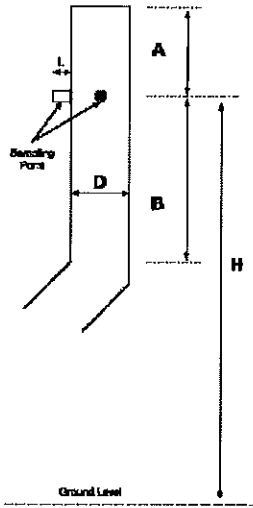

D =	10	in	Duct Diameter
L =	4	in	Port Length
A =	144	in	Distance to Downstream Disturbance
B =	132	in	Distance to Upstream Disturbance
H =	30	ft	Approximate Height Above Grade
	14.4	D	Distance to Downstream Disturbance (A)
	0.5	D	EPA M1 Requirement
	TRUE		EPA M1 Requirement Met?
	13.2	D	Distance to Upstream Disturbance (B)
	2.0	D	EPA M1 Requirement
	TRUE		EPA M1 Requirement Met?
	TRUE		EPA M1 Requirements Met for Distances to Up/Downstream Disturbances

EPA JJJJ/ZZZZ Sampling Point Requirements

<u>Duct Diameter</u>	<u>Ports</u>
D ≤ 6 inches	N/A
6 < D ≤ 12 inches	N/A
D > 12 inches	M1 Ports
D > 12 inches	no M1 Ports

Sampling Strategy

Single Point Located at Duct Centroid
 3 Traverse Points (16.7, 50.0, and 83.3%) across the duct
 3 Traverse Points (16.7, 50.0, and 83.3%) across the duct
 Stratification Check Required

REQUIRED SAMPLING STRATEGY:

8.3 in	3 Traverse Points (16.7, 50.0, and 83.3%) across the duct
5.0 in	Point 1
1.7 in	Point 2
12.3 in	Point 3
9.0 in	Point 1 Probe Mark (Includes port length)
5.7 in	Point 2 Probe Mark (Includes port length)
	Point 3 Probe Mark (Includes port length)

STRATIFICATION CHECK REQUIREMENTS

For every point (where Da=Deviation from Average (%) for a given point.)

- Da < 5 %
- 5% ≤ Da < 10 %
- Otherwise

Single Point Located at Duct Centroid
 3 Traverse Points (16.7, 50.0, and 83.3%) across the duct
 Full M1 Points Required

STRATIFICATION CHECK RESULTS

<u>Point 1</u>	<u>Point 2</u>	<u>Point 3</u>
8.07	7.95	8.00
8.00	8.09	7.93
8.08	8.10	7.85
8.08	7.98	7.94
8.01	7.97	7.91
8.09	8.07	7.91
7.97	8.01	7.93
7.94	8.14	7.97
8.01	7.99	7.93
7.99	7.98	7.92
8.07	8.00	8.01
8.00	7.97	7.98

Point Average (% O2)	8.03	8.02	7.94
Point Deviation from Average (%)	0.38	0.32	- 0.69
Point Deviation from Average (% O2)	0.03	0.03	- 0.06
Average of Point Averages (% O2)	8.00		

STRATIFICATION CHECK RESULTANT STRATEGY

Single Point Located at Duct Centroid