



**Volatile Organic Compound
Compliance Report**

**New Covert Generating Company, LLC
New Covert Generating Facility
EUTURBINE1/DB1, EUTURBINE2/DB2,
and EUTURBINE3/DB3 Stacks
Covert, Michigan
September 13 through 15, 2022**

**Report Submittal Date
October 7, 2022**

© Copyright 2022
All rights reserved in
Mostardi Platt

Project No. M223705D

TABLE OF CONTENTS

1.0 EXECUTIVE SUMMARY	1
2.0 TEST METHODOLOGY	2
Method 3A Oxygen (O ₂) Determination	2
Method 25A Volatile Organic Compound (VOC) Determination	3
Method 320 Fourier Transform Infrared (FTIR) Detector Multi-Gas Determination of Methane (CH ₄), Ethane (C ₂ H ₆) and Moisture (H ₂ O).....	3
3.0 TEST RESULT SUMMARIES	4
4.0 CERTIFICATION.....	5
APPENDIX	
Appendix A – Plant Operating Data.....	7
Appendix B - Test Section Diagram	38
Appendix C - Sample Train Diagram.....	42
Appendix D - Calculation Nomenclature and Formulas	44
Appendix E - Reference Method Test Data.....	47
Appendix F – Calibration Data.....	57
Appendix G – Gas Cylinder Certificates	83

1.0 EXECUTIVE SUMMARY

Mostardi Platt conducted a compliance emissions test program for New Covert Generating Company, LLC at the New Covert Generating Facility in Covert, Michigan, on the EUTURBINE1/DB1, EUTURBINE2/DB2, and EUTURBINE3/DB3 Stacks from September 13 through 15, 2022. This report summarizes the results of the test program and test methods used. The test locations, test dates, and test parameters are summarized below.

TEST INFORMATION		
Test Location	Test Date	Test Parameters
EUTURBINE1/DB1 Stack	September 13, 2022	Non-Methane Non-Ethane Volatile Organic Compounds (NMNE VOC), Methane (CH ₄), and Ethane (C ₂ H ₆)
EUTURBINE2/DB2 Stack	September 14, 2022	
EUTURBINE3/DB3 Stack	September 15, 2022	

New Covert owns and operates the New Covert Generating Facility located at 26000 77th Street in Covert, Michigan. The facility consists of three natural gas-fired Mitsubishi 501G turbines with heat recovery steam generators (HRSGs), designated as EU-TURBINE1, EU-TURBINE2, and EU-TURBINE3. Each HRSG contains a duct burner designated as EU-DB1, EU-DB2, and EU-DB3, respectively, to provide additional steam generating capability and increase the maximum power generating capability of the HRSG. Each duct burner is rated at approximately 256 million British thermal units per hour (MMBtu/hr). Each turbine and duct burner set are equipped with a dry low-NO_x combustor, and each HRSG is equipped with a selective catalytic reduction (SCR) system and an oxidation catalyst to control NO_x and CO emissions.

The stacks are circular and measure 22.1 feet (ft) (265 inches) in diameter at the test ports which are approximately 140 ft above grade level with an exit elevation of approximately 160 ft above grade level. The test ports are located approximately 85 ft (1020 inches) downstream and approximately 20 ft (240 inches) upstream from the nearest disturbances.

A single, dedicated CEMS is installed at each unit. The CEMS configuration includes a NO_x analyzer, a CO analyzer, a diluent gas O₂ monitor for measurements at the outlet stack, and a data acquisition and handling system (DAHS).

The purpose of the test program was to demonstrate total non-methane, non-ethane hydrocarbon emissions on the EUTURBINE2/DB1, EUTURBINE2/DB2, and EUTURBINE3/DB3 stacks. Selected results of the test program are summarized below. A complete summary of emission test results follows the narrative portion of this report.

TEST RESULTS				
Test Location	Test Parameter	Test Condition	Emission Limit	Emission Rate
EUTURBINE1/DB1 Stack	NMNE VOC	Full Load Duct Burners On	1.0 ppmv dry as CH ₄ @ 15% O ₂	0.8 ppmv dry as CH ₄ @ 15% O ₂
EUTURBINE2/DB2 Stack				0.2 ppmv dry as CH ₄ @ 15% O ₂
EUTURBINE3/DB3 Stack				0.1 ppmv dry as CH ₄ @ 15% O ₂

The identification of individuals associated with the test program is summarized below.

TEST PERSONNEL INFORMATION		
Location	Address	Contact
Test Facility	New Covert Generating Company, LLC New Covert Generating Facility 26000 77 th Street Covert, Michigan 49043	Chris Head Operations Manager (269) 764-3805 (phone) CHead@camsops.com
Testing Company Supervisor	Mostardi Platt 888 Industrial Drive Elmhurst, Illinois 60126	Damian Panek Project Manager 630-993-2100 (phone) dpanek@mp-mail.com

The test program was conducted by E. Riha and D. Panek of Mostardi Platt.

2.0 TEST METHODOLOGY

Emission testing was conducted following the methods specified in 40 CFR, Part 60, Appendix A, and 40 CFR, Part 63, Appendix A. Schematics of the test section diagrams and sampling trains used are included in Appendix B and C, respectively. Calculation examples and nomenclature are included in Appendix D. Copies of analyzer print-outs for each test run are included in Appendix E.

The following methodologies were used during the test program:

Method 3A Oxygen (O₂) Determination

Flue gas O₂ was determined in accordance with Method 3A. An ECOM analyzer was used to determine stack gas oxygen content and was connected to the outlet of the FTIR analyzer.

Stack gas was delivered to the analyzer via a Teflon® sampling line, heated to a minimum temperature of 375°F. The entire system was calibrated in accordance with the Method, using certified calibration gases introduced at the probe, before and after each test run.

All of the equipment used was calibrated in accordance with the specifications of the Method and calibration data are included in Appendix F. Copies of the gas cylinder certifications are included in Appendix G.

Method 25A Volatile Organic Compound (VOC) Determination

VOC concentrations and emission rates were determined in accordance with Method 25A. A Thermo 51i flame ionization detector (FID) analyzer was used to determine total hydrocarbon (THC) concentrations, while Method 320 was performed simultaneously to subtract CH₄ and C₂H₆ concentrations to determine VOC. Stack gas was delivered to the system via a Teflon® sampling line, heated to a minimum temperature of 300°F. Sample was delivered first to the Method 320 FTIR analyzer, with the Method 25A FID analyzer connected to the exhaust of the FTIR analyzer.

The system was calibrated before and after each test run using certified calibration gases of methane for the THC determination. Methane and ethane concentrations were then subtracted based upon the simultaneous data collected and recorded by the FTIR analyzer. A list of calibration gases used and the results of all calibration and other required quality assurance checks can be found in Appendix F. Copies of calibration gas certifications can be found in Appendix G.

Method 320 Fourier Transform Infrared (FTIR) Detector Multi-Gas Determination of Methane (CH₄), Ethane (C₂H₆) and Moisture (H₂O)

The Method 320 sampling and measurement system meets the requirements of US EPA Reference Method 320, "Vapor Phase Organic and Inorganic Emissions by Extractive FTIR," 40CFR63, Appendix A. This method applies to the measurement of methane, ethane, and moisture concentrations. USEPA Method 4, 40CFR60, specifies method 320 as an acceptable alternative for moisture determination.

With this method, gas samples are extracted from the sample locations through heated Teflon sample lines to the analyzers. FTIR technology works on the principle that most gases absorb infrared light. This is true for all compounds with the exception of homonuclear diatomic molecules and noble gases such as: N₂, O₂, H₂, He, Ne, and Ar. Vibrations, stretches, bends, and rotations within the bonds of a molecule determine the infrared absorption distinctiveness. The absorption creates a "fingerprint" which is unique to each given compound. The quantity of infrared light absorbed is proportional to the gas concentration. Most compounds have absorbencies at different infrared frequencies, thus allowing the simultaneous analysis of multiple compounds at one time. The FTIR software compares each sample spectrum to a user selected list of calibration references and concentration data is generated.

FTIR data was collected using an MKS MultiGas 2030 FTIR spectrometer. Spiking was performed following each test run to verify the ability of the sampling system to quantitatively deliver a sample containing volatile organic compounds from the base of the probe to the FTIR. Analyte spiking assures the ability of the FTIR to quantify analytes of interest in the presence of effluent gas. All analyte spikes were introduced using an instrument grade stainless steel rotameter. All QA/QC procedures were within the acceptance criteria allowance of Method 320. All of the equipment used was calibrated in accordance with the specifications of the Method. Calibration data are presented in Appendix F.

Methane and ethane concentrations were subtracted from the total hydrocarbon emissions to determine non-methane non-ethane volatile organic emissions from each unit. Moisture numbers were used to calculate emissions on a dry basis.

3.0 TEST RESULT SUMMARIES

New Covert Generating Company, LLC New Covert Generating Facility Unit 001 VOC Summary - Full Load With Duct Burners											
Test No.	Date	Start Time	End Time	H ₂ O (%v)	O ₂ (%v dry)	THC ppm as CH ₄ (wet)	C ₂ H ₆ ppm as CH ₄ (wet)	CH ₄ ppm as CH ₄ (wet)	VOC ppm as CH ₄ (wet)	VOC ppm as CH ₄ (dry)	VOC ppmv dry as CH ₄ @ 15% O ₂
1	09/13/22	10:15	11:50	9.5	12.6	1.2	0.2	0.0	0.9	1.0	0.7
2	09/13/22	12:10	13:36	9.7	12.6	1.3	0.2	0.0	1.1	1.3	0.9
3	09/13/22	13:55	15:20	9.8	12.6	1.3	0.2	0.0	1.1	1.2	0.8
Average				9.7	12.6	1.3	0.2	0.0	1.0	1.2	0.8

New Covert Generating Company, LLC New Covert Generating Facility Unit 002 VOC Summary - Full Load With Duct Burners											
Test No.	Date	Start Time	End Time	H ₂ O (%v)	O ₂ (%v dry)	THC ppm as CH ₄ (wet)	C ₂ H ₆ ppm as CH ₄ (wet)	CH ₄ ppm as CH ₄ (wet)	VOC ppm as CH ₄ (wet)	VOC ppm as CH ₄ (dry)	VOC ppmv dry as CH ₄ @ 15% O ₂
1	09/14/22	9:25	10:48	9.7	12.6	0.3	0.0	0.0	0.2	0.3	0.2
2	09/14/22	11:06	12:27	9.7	12.6	0.2	0.0	0.0	0.2	0.2	0.2
3	09/14/22	12:44	14:06	9.6	12.6	0.3	0.0	0.0	0.3	0.3	0.2
Average				9.7	12.6	0.3	0.0	0.0	0.3	0.3	0.2

New Covert Generating Company, LLC New Covert Generating Facility Unit 003 VOC Summary - Full Load With Duct Burners											
Test No.	Date	Start Time	End Time	H ₂ O (%v)	O ₂ (%v dry)	THC ppm as CH ₄ (wet)	C ₂ H ₆ ppm as CH ₄ (wet)	CH ₄ ppm as CH ₄ (wet)	VOC ppm as CH ₄ (wet)	VOC ppm as CH ₄ (dry)	VOC ppmv dry as CH ₄ @ 15% O ₂
1	09/15/22	9:13	10:35	9.1	12.7	0.2	0.2	0.0	0.1	0.1	0.0
2	09/15/22	10:52	12:14	9.2	12.8	0.3	0.1	0.0	0.2	0.2	0.1
3	09/15/22	12:29	13:52	9.0	12.9	0.1	0.1	0.0	0.0	0.0	0.0
Average				9.1	12.8	0.2	0.1	0.0	0.1	0.1	0.1

4.0 CERTIFICATION

Mostardi Platt is pleased to have been of service to New Covert Generating Company, LLC. If you have any questions regarding this test report, please do not hesitate to contact us at 630-993-2100.

As project manager, I hereby certify that this test report represents a true and accurate summary of emissions test results and the methodologies employed to obtain those results, and the test program was performed in accordance with the methods specified in this test report.

MOSTARDI PLATT



Damian P. Panek

Program Manager



Eric Ehlers

Quality Assurance

APPENDICES

Appendix A - Plant Operating Data

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/13/2022 10:15 Through 09/13/2022 15:58

Time Online Criteria: 1 minute(s)

Source Parameter Unit	UNIT01											
	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 1												
09/13/22 10:15	0.1	0.000	0.0	1,051.6	2,699.8	237	0.007	2.5	1.8	12.6	106.6	146
09/13/22 10:16	0.2	0.000	0.1	1,051.6	2,705.1	238	0.007	2.6	1.8	12.5	106.8	146
09/13/22 10:17	0.4	0.000	0.1	1,051.6	2,703.4	237	0.007	2.6	1.8	12.6	106.8	146
09/13/22 10:18	0.5	0.000	0.1	1,051.6	2,708.6	238	0.007	2.6	1.8	12.5	107.0	146
09/13/22 10:19	0.5	0.000	0.1	1,051.6	2,703.2	237	0.006	2.5	1.8	12.5	106.7	146
09/13/22 10:20	0.6	0.000	0.1	1,051.6	2,706.5	237	0.007	2.5	1.8	12.6	106.9	146
09/13/22 10:21	0.7	0.000	0.2	1,051.6	2,709.4	237	0.006	2.5	1.8	12.5	107.0	146
09/13/22 10:22	0.7	0.000	0.2	1,051.6	2,700.2	237	0.006	2.5	1.8	12.5	106.6	146
09/13/22 10:23	0.8	0.000	0.2	1,051.5	2,704.4	237	0.007	2.6	1.8	12.5	106.8	146
09/13/22 10:24	0.6	0.000	0.1	1,051.5	2,702.7	237	0.007	2.6	1.8	12.5	106.7	146
09/13/22 10:25	0.5	0.000	0.1	1,051.5	2,702.9	237	0.007	2.6	1.8	12.6	106.7	146
09/13/22 10:26	0.4	0.000	0.1	1,051.5	2,706.5	237	0.006	2.5	1.8	12.5	106.9	146
09/13/22 10:27	0.4	0.000	0.1	1,051.5	2,705.6	237	0.006	2.5	1.8	12.5	106.9	146
09/13/22 10:28	0.3	0.000	0.1	1,051.5	2,704.4	237	0.006	2.5	1.8	12.5	106.8	146
09/13/22 10:29	0.3	0.000	0.1	1,051.5	2,699.3	236	0.007	2.6	1.8	12.5	106.6	146
09/13/22 10:30	0.3	0.000	0.1	1,051.5	2,693.9	236	0.007	2.6	1.8	12.6	106.4	146
09/13/22 10:31	0.2	0.000	0.1	1,051.5	2,699.9	237	0.007	2.5	1.8	12.6	106.6	146
09/13/22 10:32	0.2	0.000	0.1	1,051.5	2,700.9	237	0.007	2.5	1.8	12.6	106.7	146
09/13/22 10:33	0.2	0.000	0.1	1,051.5	2,704.3	237	0.006	2.5	1.8	12.5	106.8	146
09/13/22 10:34	0.4	0.000	0.1	1,051.5	2,696.8	236	0.007	2.6	1.8	12.5	106.5	146
09/13/22 10:35	0.8	0.000	0.2	1,051.5	2,697.6	237	0.007	2.6	1.8	12.5	106.5	146
Average	0.4	0.0	0.1	1,051.5	2,702.6	237.0	0.0	2.5	1.8	12.5	106.7	146.0

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/13/2022 10:15 Through 09/13/2022 15:58

Time Online Criteria: 1 minute(s)

Parameter Unit	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 2												
09/13/22 10:50	0.3	0.000	0.1	1,051.5	2,706.0	237	0.006	2.5	1.8	12.5	106.9	146
09/13/22 10:51	0.4	0.000	0.1	1,051.5	2,699.9	237	0.006	2.4	1.7	12.6	106.6	146
09/13/22 10:52	0.6	0.000	0.1	1,051.5	2,708.0	237	0.006	2.4	1.7	12.5	107.0	146
09/13/22 10:53	0.6	0.000	0.1	1,051.6	2,704.6	237	0.006	2.5	1.8	12.5	106.8	146
09/13/22 10:54	0.7	0.000	0.2	1,051.6	2,700.7	237	0.007	2.7	1.9	12.5	106.6	146
09/13/22 10:55	0.5	0.000	0.1	1,051.6	2,702.1	237	0.007	2.7	1.9	12.5	106.7	146
09/13/22 10:56	0.4	0.000	0.1	1,051.6	2,703.9	237	0.007	2.6	1.8	12.5	106.8	146
09/13/22 10:57	0.2	0.000	0.0	1,051.6	2,700.8	237	0.006	2.5	1.7	12.5	106.6	146
09/13/22 10:58	0.2	0.000	0.1	1,051.6	2,703.1	237	0.007	2.5	1.7	12.6	106.7	146
09/13/22 10:59	0.2	0.000	0.0	1,051.6	2,709.8	237	0.007	2.5	1.8	12.6	107.0	146
09/13/22 11:00	0.1	0.000	0.0	1,051.6	2,703.2	237	0.007	2.6	1.8	12.5	106.7	146
09/13/22 11:01	0.2	0.000	0.0	1,051.6	2,698.0	236	0.007	2.7	1.9	12.6	106.5	146
09/13/22 11:02	0.1	0.000	0.0	1,051.6	2,705.1	237	0.007	2.7	1.9	12.6	106.8	146
09/13/22 11:03	0.1	0.000	0.0	1,051.6	2,700.2	237	0.006	2.5	1.8	12.5	106.6	146
09/13/22 11:04	0.1	0.000	0.0	1,051.6	2,698.4	236	0.006	2.4	1.7	12.6	106.5	146
09/13/22 11:05	0.3	0.000	0.1	1,051.6	2,705.1	237	0.006	2.4	1.7	12.6	106.8	146
09/13/22 11:06	0.6	0.000	0.2	1,051.5	2,702.0	237	0.007	2.6	1.8	12.5	106.7	146
09/13/22 11:07	0.8	0.000	0.2	1,051.5	2,694.7	236	0.007	2.7	1.9	12.5	106.4	146
09/13/22 11:08	0.8	0.000	0.2	1,051.5	2,695.1	236	0.007	2.7	1.9	12.5	106.4	146
09/13/22 11:09	0.6	0.000	0.1	1,051.5	2,703.0	237	0.006	2.5	1.8	12.5	106.7	146
09/13/22 11:10	0.8	0.000	0.2	1,051.5	2,704.5	237	0.006	2.4	1.7	12.5	106.8	146
Average	0.4	0.000	0.1	1,051.6	2,702.3	237	0.007	2.5	1.8	12.5	106.7	146

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/13/2022 10:15 Through 09/13/2022 15:58

Time Online Criteria: 1 minute(s)

Parameter Unit	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 3												
09/13/22 11:30	0.4	0.000	0.1	1,051.4	2,701.2	236	0.006	2.5	1.7	12.5	106.7	146
09/13/22 11:31	0.3	0.000	0.1	1,051.4	2,698.6	236	0.007	2.6	1.8	12.5	106.6	146
09/13/22 11:32	0.4	0.000	0.1	1,051.4	2,702.2	236	0.007	2.7	1.9	12.5	106.7	146
09/13/22 11:33	0.4	0.000	0.1	1,051.4	2,698.4	236	0.007	2.6	1.9	12.5	106.5	146
09/13/22 11:34	0.3	0.000	0.1	1,051.4	2,700.7	236	0.006	2.5	1.8	12.5	106.6	146
09/13/22 11:35	0.5	0.000	0.1	1,051.4	2,704.8	237	0.006	2.4	1.7	12.5	106.8	146
09/13/22 11:36	0.4	0.000	0.1	1,051.4	2,696.7	236	0.006	2.5	1.7	12.5	106.5	146
09/13/22 11:37	0.4	0.000	0.1	1,051.4	2,695.9	236	0.007	2.6	1.8	12.5	106.4	146
09/13/22 11:38	0.4	0.000	0.1	1,051.4	2,700.2	236	0.007	2.6	1.9	12.5	106.6	146
09/13/22 11:39	0.7	0.000	0.2	1,051.4	2,694.6	235	0.007	2.6	1.8	12.5	106.4	146
09/13/22 11:40	0.8	0.000	0.2	1,051.4	2,692.0	235	0.006	2.5	1.8	12.5	106.3	146
09/13/22 11:41	1.1	0.000	0.2	1,051.4	2,695.3	235	0.006	2.5	1.8	12.5	106.4	145
09/13/22 11:42	0.8	0.000	0.2	1,051.4	2,695.7	235	0.006	2.5	1.8	12.5	106.4	146
09/13/22 11:43	0.8	0.000	0.2	1,051.4	2,690.7	235	0.007	2.6	1.8	12.5	106.2	146
09/13/22 11:44	0.7	0.000	0.2	1,051.4	2,692.0	235	0.007	2.6	1.8	12.5	106.3	146
09/13/22 11:45	0.4	0.000	0.1	1,051.4	2,697.1	236	0.007	2.6	1.8	12.5	106.5	145
09/13/22 11:46	0.3	0.000	0.1	1,051.4	2,689.6	235	0.007	2.5	1.8	12.6	106.2	145
09/13/22 11:47	0.3	0.000	0.1	1,051.3	2,700.1	236	0.006	2.5	1.8	12.5	106.6	145
09/13/22 11:48	0.1	0.000	0.0	1,051.3	2,698.1	236	0.006	2.5	1.8	12.5	106.5	145
09/13/22 11:49	0.1	0.000	0.0	1,051.3	2,694.3	235	0.007	2.6	1.8	12.5	106.4	145
09/13/22 11:50	0.2	0.000	0.0	1,051.3	2,706.7	236	0.007	2.6	1.8	12.5	106.9	145
Average	0.5	0.0	0.1	1,051.4	2,697.4	235.7	0.007	2.6	1.8	12.5	106.5	146

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/13/2022 10:15 Through 09/13/2022 15:58

Time Online Criteria: 1 minute(s)

Parameter Unit	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 4												
09/13/22 12:10	0.5	0.000	0.1	1,051.3	2,689.4	235	0.007	2.6	1.8	12.6	106.2	145
09/13/22 12:11	0.6	0.000	0.1	1,051.3	2,690.6	235	0.007	2.5	1.8	12.6	106.2	145
09/13/22 12:12	0.5	0.000	0.1	1,051.3	2,695.4	236	0.006	2.4	1.7	12.6	106.4	145
09/13/22 12:13	0.5	0.000	0.1	1,051.3	2,697.7	236	0.006	2.4	1.7	12.5	106.5	145
09/13/22 12:14	0.5	0.000	0.1	1,051.3	2,696.3	236	0.006	2.5	1.8	12.5	106.5	145
09/13/22 12:15	0.5	0.000	0.1	1,051.3	2,695.7	236	0.007	2.7	1.9	12.5	106.4	145
09/13/22 12:16	0.5	0.000	0.1	1,051.3	2,700.5	236	0.007	2.7	1.9	12.5	106.6	145
09/13/22 12:17	0.6	0.000	0.1	1,051.2	2,696.6	236	0.006	2.5	1.8	12.5	106.5	145
09/13/22 12:18	0.4	0.000	0.1	1,051.2	2,696.5	236	0.006	2.4	1.7	12.6	106.5	145
09/13/22 12:19	0.1	0.000	0.0	1,051.2	2,698.4	236	0.006	2.4	1.7	12.5	106.6	145
09/13/22 12:20	0.2	0.000	0.0	1,051.2	2,697.6	236	0.006	2.5	1.8	12.5	106.5	146
09/13/22 12:21	0.1	0.000	0.0	1,051.2	2,703.7	236	0.007	2.6	1.9	12.5	106.8	146
09/13/22 12:22	0.2	0.000	0.0	1,051.2	2,699.8	236	0.007	2.7	1.9	12.5	106.6	146
09/13/22 12:23	0.1	0.000	0.0	1,051.1	2,701.2	236	0.007	2.6	1.9	12.5	106.7	146
09/13/22 12:24	0.2	0.000	0.0	1,051.1	2,702.2	236	0.006	2.5	1.8	12.5	106.7	146
09/13/22 12:25	0.2	0.000	0.0	1,051.1	2,698.2	236	0.006	2.4	1.7	12.5	106.6	146
09/13/22 12:26	0.4	0.000	0.1	1,051.1	2,697.6	236	0.006	2.5	1.7	12.5	106.5	146
09/13/22 12:27	0.7	0.000	0.2	1,051.1	2,699.3	236	0.007	2.6	1.8	12.5	106.6	146
09/13/22 12:28	0.6	0.000	0.1	1,051.1	2,694.0	236	0.007	2.6	1.9	12.5	106.4	146
09/13/22 12:29	0.6	0.000	0.2	1,050.8	2,695.2	236	0.007	2.6	1.9	12.5	106.5	146
09/13/22 12:30	0.7	0.000	0.2	1,050.8	2,697.9	236	0.006	2.5	1.8	12.5	106.6	146
Average	0.4	0.000	0.1	1,051.2	2,697.3	236	0.006	2.5	1.8	12.5	106.5	146

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/13/2022 10:15 Through 09/13/2022 15:58

Time Online Criteria: 1 minute(s)

Parameter Unit	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 5												
09/13/22 12:45	0.8	0.000	0.2	1,050.7	2,673.7	233	0.006	2.4	1.7	12.5	105.6	144
09/13/22 12:46	0.8	0.000	0.2	1,050.7	2,670.1	233	0.007	2.5	1.8	12.6	105.4	145
09/13/22 12:47	0.8	0.000	0.2	1,050.7	2,677.0	233	0.007	2.6	1.8	12.5	105.7	145
09/13/22 12:48	0.8	0.000	0.2	1,050.6	2,672.7	233	0.007	2.6	1.8	12.5	105.5	145
09/13/22 12:49	0.5	0.000	0.1	1,050.6	2,667.3	232	0.007	2.6	1.8	12.6	105.3	144
09/13/22 12:50	0.5	0.000	0.1	1,050.6	2,672.9	233	0.006	2.5	1.8	12.5	105.5	144
09/13/22 12:51	0.4	0.000	0.1	1,050.6	2,672.1	233	0.006	2.4	1.7	12.5	105.5	144
09/13/22 12:52	0.3	0.000	0.1	1,050.6	2,664.3	232	0.006	2.5	1.8	12.5	105.2	144
09/13/22 12:53	0.1	0.000	0.0	1,050.6	2,669.7	233	0.007	2.7	1.9	12.6	105.4	144
09/13/22 12:54	0.2	0.000	0.0	1,050.6	2,673.1	233	0.007	2.7	1.9	12.5	105.5	144
09/13/22 12:55	0.1	0.000	0.0	1,050.6	2,666.1	233	0.007	2.6	1.8	12.5	105.3	144
09/13/22 12:56	0.2	0.000	0.0	1,050.6	2,671.1	233	0.007	2.5	1.8	12.6	105.5	144
09/13/22 12:57	0.2	0.000	0.0	1,050.6	2,676.6	234	0.006	2.4	1.7	12.5	105.7	144
09/13/22 12:58	0.4	0.000	0.1	1,050.6	2,675.2	233	0.006	2.4	1.7	12.5	105.6	144
09/13/22 12:59	0.6	0.000	0.1	1,050.7	2,673.1	233	0.006	2.5	1.8	12.5	105.5	144
09/13/22 13:00	0.7	0.000	0.2	1,050.7	2,681.1	234	0.007	2.6	1.8	12.5	105.9	144
09/13/22 13:01	0.6	0.000	0.1	1,050.7	2,678.1	234	0.007	2.6	1.8	12.5	105.8	144
09/13/22 13:02	0.7	0.000	0.2	1,050.7	2,680.0	234	0.007	2.6	1.8	12.5	105.8	145
09/13/22 13:03	0.6	0.000	0.1	1,050.7	2,683.7	234	0.006	2.5	1.8	12.5	106.0	145
09/13/22 13:04	0.6	0.000	0.1	1,050.7	2,685.8	235	0.006	2.5	1.7	12.5	106.1	145
09/13/22 13:05	0.5	0.000	0.1	1,050.7	2,683.4	234	0.006	2.5	1.8	12.5	106.0	145
Average	0.5	0.000	0.1	1,050.6	2,674.6	233	0.007	2.5	1.8	12.5	105.6	144

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/13/2022 10:15 Through 09/13/2022 15:58

Time Online Criteria: 1 minute(s)

Parameter Unit	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run6												
09/13/22 13:16	0.3	0.000	0.1	1,050.7	2,677.9	234	0.006	2.5	1.8	12.5	105.7	145
09/13/22 13:17	0.5	0.000	0.1	1,050.7	2,684.1	234	0.006	2.5	1.8	12.5	106.0	145
09/13/22 13:18	0.5	0.000	0.1	1,050.7	2,688.4	235	0.006	2.5	1.8	12.5	106.2	145
09/13/22 13:19	0.3	0.000	0.1	1,050.7	2,679.3	234	0.007	2.6	1.8	12.5	105.8	145
09/13/22 13:20	0.4	0.000	0.1	1,050.7	2,680.5	234	0.007	2.6	1.9	12.5	105.9	145
09/13/22 13:21	0.4	0.000	0.1	1,050.7	2,683.4	234	0.007	2.6	1.8	12.5	106.0	145
09/13/22 13:22	0.2	0.000	0.0	1,050.7	2,680.3	233	0.006	2.5	1.8	12.5	105.8	145
09/13/22 13:23	0.2	0.000	0.0	1,050.7	2,678.9	233	0.006	2.5	1.7	12.5	105.8	145
09/13/22 13:24	0.1	0.000	0.0	1,050.7	2,678.7	233	0.006	2.5	1.8	12.5	105.8	144
09/13/22 13:25	0.2	0.000	0.0	1,050.7	2,674.5	233	0.007	2.6	1.8	12.6	105.6	144
09/13/22 13:26	0.2	0.000	0.0	1,050.7	2,674.6	233	0.007	2.6	1.9	12.5	105.6	144
09/13/22 13:27	0.1	0.000	0.0	1,050.7	2,674.2	233	0.007	2.6	1.8	12.5	105.6	144
09/13/22 13:28	0.1	0.000	0.0	1,050.7	2,673.1	233	0.006	2.5	1.8	12.5	105.5	144
09/13/22 13:29	0.2	0.000	0.1	1,050.7	2,675.7	233	0.006	2.5	1.8	12.5	105.6	144
09/13/22 13:30	0.3	0.000	0.1	1,050.7	2,672.3	233	0.007	2.5	1.8	12.6	105.5	144
09/13/22 13:31	0.2	0.000	0.1	1,050.7	2,677.3	233	0.006	2.5	1.8	12.5	105.7	144
09/13/22 13:32	0.4	0.000	0.1	1,050.7	2,674.0	233	0.007	2.6	1.8	12.5	105.6	144
09/13/22 13:33	0.6	0.000	0.1	1,050.7	2,673.7	233	0.007	2.6	1.9	12.5	105.6	144
09/13/22 13:34	0.5	0.000	0.1	1,050.7	2,676.1	234	0.007	2.6	1.8	12.5	105.7	144
09/13/22 13:35	0.6	0.000	0.1	1,050.7	2,677.6	234	0.006	2.5	1.7	12.5	105.7	144
09/13/22 13:36	0.6	0.000	0.1	1,050.8	2,678.5	233	0.006	2.5	1.8	12.5	105.8	144
Average	0.3	0.0	0.1	1,050.7	2,677.8	233.4	0.006	2.5	1.8	12.5	105.7	144

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/13/2022 10:15 Through 09/13/2022 15:58

Time Online Criteria: 1 minute(s)

Parameter Unit	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 7												
09/13/22 13:55	0.3	0.000	0.1	1,050.9	2,668.9	233	0.007	2.6	1.8	12.5	105.3	144
09/13/22 13:56	0.1	0.000	0.0	1,050.9	2,673.0	233	0.007	2.6	1.8	12.5	105.5	144
09/13/22 13:57	0.2	0.000	0.1	1,050.9	2,675.2	233	0.007	2.5	1.8	12.6	105.6	144
09/13/22 13:58	0.1	0.000	0.0	1,050.9	2,669.7	233	0.006	2.5	1.8	12.5	105.4	144
09/13/22 13:59	0.1	0.000	0.0	1,050.9	2,672.6	232	0.006	2.5	1.8	12.5	105.5	144
09/13/22 14:00	0.1	0.000	0.0	1,050.9	2,668.8	233	0.007	2.6	1.8	12.5	105.3	144
09/13/22 14:01	0.1	0.000	0.0	1,050.9	2,670.9	232	0.007	2.6	1.8	12.5	105.4	144
09/13/22 14:02	0.1	0.000	0.0	1,050.9	2,668.8	232	0.007	2.6	1.8	12.5	105.3	144
09/13/22 14:03	0.1	0.000	0.0	1,050.9	2,669.9	233	0.006	2.5	1.8	12.5	105.4	144
09/13/22 14:04	0.2	0.000	0.0	1,050.9	2,670.7	233	0.006	2.5	1.7	12.5	105.4	144
09/13/22 14:05	0.1	0.000	0.0	1,051.0	2,672.1	233	0.006	2.5	1.8	12.5	105.5	144
09/13/22 14:06	0.2	0.000	0.1	1,051.0	2,668.6	232	0.007	2.6	1.8	12.5	105.3	144
09/13/22 14:07	0.3	0.000	0.1	1,051.0	2,671.6	233	0.007	2.6	1.8	12.5	105.5	144
09/13/22 14:08	0.3	0.000	0.1	1,051.0	2,671.4	232	0.007	2.6	1.8	12.5	105.4	144
09/13/22 14:09	0.5	0.000	0.1	1,051.0	2,665.8	232	0.006	2.5	1.8	12.5	105.2	144
09/13/22 14:10	0.3	0.000	0.1	1,051.0	2,666.2	232	0.006	2.5	1.8	12.5	105.3	144
09/13/22 14:11	0.1	0.000	0.0	1,051.1	2,662.0	232	0.006	2.5	1.8	12.5	105.0	144
09/13/22 14:12	0.1	0.000	0.0	1,051.1	2,664.5	232	0.007	2.6	1.8	12.5	105.1	144
09/13/22 14:13	0.1	0.000	0.0	1,051.1	2,667.1	232	0.007	2.6	1.8	12.5	105.2	144
09/13/22 14:14	0.1	0.000	0.0	1,051.1	2,670.8	232	0.007	2.6	1.8	12.5	105.4	144
09/13/22 14:15	0.2	0.000	0.0	1,051.1	2,662.2	232	0.007	2.6	1.8	12.5	105.0	144
Average	0.2	0.00	0.0	1,051.0	2,669.2	232	0.007	2.6	1.8	12.5	105.3	144

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/13/2022 10:15 Through 09/13/2022 15:58

Time Online Criteria: 1 minute(s)

Parameter Unit	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 8												
09/13/22 14:26	0.5	0.000	0.1	1,051.1	2,667.0	232	0.007	2.6	1.8	12.5	105.2	144
09/13/22 14:27	0.3	0.000	0.1	1,051.1	2,665.3	232	0.007	2.6	1.8	12.5	105.2	144
09/13/22 14:28	0.1	0.000	0.0	1,051.1	2,664.8	232	0.007	2.6	1.8	12.5	105.1	144
09/13/22 14:29	0.1	0.000	0.0	1,051.1	2,665.0	232	0.007	2.5	1.8	12.6	105.2	144
09/13/22 14:30	0.1	0.000	0.0	1,051.0	2,664.5	232	0.006	2.5	1.8	12.5	105.1	144
09/13/22 14:31	0.1	0.000	0.0	1,051.0	2,668.2	232	0.007	2.5	1.8	12.6	105.3	144
09/13/22 14:32	0.1	0.000	0.0	1,051.0	2,662.0	232	0.007	2.6	1.8	12.5	105.0	144
09/13/22 14:33	0.1	0.000	0.0	1,051.0	2,663.9	232	0.007	2.6	1.8	12.5	105.1	144
09/13/22 14:34	0.1	0.000	0.0	1,051.0	2,661.5	232	0.007	2.6	1.8	12.5	105.0	144
09/13/22 14:35	0.1	0.000	0.0	1,051.0	2,665.0	232	0.007	2.5	1.8	12.6	105.2	144
09/13/22 14:36	0.3	0.000	0.1	1,050.9	2,663.9	232	0.006	2.5	1.7	12.5	105.1	144
09/13/22 14:37	0.3	0.000	0.1	1,050.9	2,664.1	232	0.006	2.5	1.8	12.5	105.1	144
09/13/22 14:38	0.5	0.000	0.1	1,050.9	2,662.9	232	0.007	2.6	1.8	12.5	105.1	144
09/13/22 14:39	0.3	0.000	0.1	1,050.9	2,655.7	231	0.007	2.7	1.9	12.5	104.8	144
09/13/22 14:40	0.4	0.000	0.1	1,050.9	2,658.0	231	0.007	2.6	1.9	12.6	104.9	144
09/13/22 14:41	0.4	0.000	0.1	1,050.9	2,657.3	231	0.006	2.5	1.7	12.5	104.9	144
09/13/22 14:42	0.3	0.000	0.1	1,050.9	2,655.1	231	0.006	2.4	1.7	12.6	104.8	144
09/13/22 14:43	0.1	0.000	0.0	1,050.9	2,658.9	232	0.006	2.5	1.7	12.5	104.9	144
09/13/22 14:44	0.1	0.000	0.0	1,050.9	2,662.3	232	0.007	2.6	1.8	12.5	105.1	144
09/13/22 14:45	0.1	0.000	0.0	1,050.9	2,652.2	231	0.007	2.7	1.9	12.5	104.6	144
09/13/22 14:46	0.1	0.000	0.0	1,050.9	2,653.3	231	0.007	2.7	1.9	12.6	104.7	144
Average	0.2	0.000	0.0	1,051.0	2,661.5	232	0.007	2.6	1.8	12.5	105.0	144

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/13/2022 10:15 Through 09/13/2022 15:58

Time Online Criteria: 1 minute(s)

Parameter Unit	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 9												
09/13/22 15:00	0.2	0.000	0.1	1,051.0	2,621.1	230	0.006	2.5	1.8	12.5	103.3	144
09/13/22 15:01	0.1	0.000	0.0	1,051.0	2,622.4	231	0.007	2.5	1.7	12.6	103.4	144
09/13/22 15:02	0.1	0.000	0.0	1,051.0	2,623.8	230	0.006	2.5	1.8	12.5	103.4	144
09/13/22 15:03	0.1	0.000	0.0	1,051.0	2,618.5	230	0.007	2.6	1.8	12.6	103.2	144
09/13/22 15:04	0.1	0.000	0.0	1,051.0	2,624.2	231	0.007	2.7	1.9	12.6	103.4	144
09/13/22 15:05	0.1	0.000	0.0	1,051.1	2,621.8	231	0.007	2.6	1.8	12.5	103.3	144
09/13/22 15:06	0.1	0.000	0.0	1,051.2	2,621.9	230	0.007	2.5	1.7	12.6	103.3	144
09/13/22 15:07	0.1	0.000	0.0	1,051.2	2,637.3	231	0.006	2.4	1.7	12.6	104.0	144
09/13/22 15:08	0.2	0.000	0.0	1,051.2	2,639.7	231	0.006	2.4	1.7	12.5	104.1	144
09/13/22 15:09	0.3	0.000	0.1	1,051.2	2,640.3	231	0.006	2.5	1.7	12.5	104.1	144
09/13/22 15:10	0.5	0.000	0.1	1,051.2	2,636.8	230	0.007	2.6	1.9	12.5	103.9	144
09/13/22 15:11	0.6	0.000	0.1	1,051.3	2,644.5	231	0.007	2.7	1.9	12.5	104.3	144
09/13/22 15:12	0.4	0.000	0.1	1,051.3	2,648.2	231	0.006	2.5	1.8	12.5	104.4	144
09/13/22 15:13	0.4	0.000	0.1	1,051.3	2,650.3	231	0.006	2.4	1.7	12.5	104.5	144
09/13/22 15:14	0.2	0.000	0.0	1,051.3	2,651.9	231	0.006	2.5	1.7	12.5	104.6	144
09/13/22 15:15	0.1	0.000	0.0	1,051.3	2,650.1	232	0.007	2.6	1.8	12.5	104.5	144
09/13/22 15:16	0.1	0.000	0.0	1,051.3	2,644.1	231	0.007	2.6	1.9	12.5	104.2	144
09/13/22 15:17	0.1	0.000	0.0	1,051.3	2,641.5	231	0.007	2.7	1.9	12.5	104.1	144
09/13/22 15:18	0.1	0.000	0.0	1,051.4	2,656.3	232	0.007	2.6	1.8	12.5	104.8	144
09/13/22 15:19	0.1	0.000	0.0	1,051.4	2,654.9	232	0.006	2.4	1.7	12.5	104.7	144
09/13/22 15:20	0.1	0.000	0.0	1,051.4	2,643.4	231	0.006	2.3	1.6	12.5	104.2	144
Average	0.2	0.000	0.0	1,051.3	2,642.7	231	0.007	2.5	1.8	12.5	104.2	144

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/13/2022 10:15 Through 09/13/2022 15:58

Time Online Criteria: 1 minute(s)

Parameter Unit	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run												
10												
09/13/22 15:38	0.1	0.000	0.0	1,051.5	2,630.9	232	0.006	2.5	1.8	12.5	103.7	144
09/13/22 15:39	0.1	0.000	0.0	1,051.5	2,631.2	231	0.006	2.5	1.8	12.5	103.7	144
09/13/22 15:40	0.2	0.000	0.1	1,051.5	2,631.7	232	0.007	2.5	1.8	12.6	103.7	144
09/13/22 15:41	0.3	0.000	0.1	1,051.7	2,638.4	232	0.006	2.5	1.8	12.5	104.0	144
09/13/22 15:42	0.5	0.000	0.1	1,051.7	2,636.7	232	0.007	2.6	1.8	12.5	103.9	144
09/13/22 15:43	0.4	0.000	0.1	1,051.7	2,633.5	232	0.007	2.6	1.8	12.5	103.8	144
09/13/22 15:44	0.5	0.000	0.1	1,051.7	2,635.4	232	0.007	2.6	1.8	12.5	103.8	144
09/13/22 15:45	0.4	0.000	0.1	1,051.7	2,638.2	232	0.006	2.5	1.8	12.5	104.0	144
09/13/22 15:46	0.5	0.000	0.1	1,051.7	2,639.5	232	0.006	2.5	1.7	12.5	104.0	144
09/13/22 15:47	0.4	0.000	0.1	1,051.7	2,638.2	233	0.006	2.5	1.8	12.5	104.0	144
09/13/22 15:48	0.4	0.000	0.1	1,051.7	2,639.8	233	0.007	2.6	1.9	12.5	104.0	144
09/13/22 15:49	0.1	0.000	0.0	1,051.7	2,640.7	232	0.007	2.7	1.9	12.5	104.1	144
09/13/22 15:50	0.1	0.000	0.0	1,051.7	2,636.0	232	0.007	2.6	1.8	12.5	103.9	144
09/13/22 15:51	0.1	0.000	0.0	1,051.7	2,634.1	232	0.007	2.5	1.8	12.6	103.8	144
09/13/22 15:52	0.1	0.000	0.0	1,051.7	2,642.3	233	0.006	2.4	1.7	12.5	104.1	144
09/13/22 15:53	0.1	0.000	0.0	1,052.9	2,632.4	232	0.006	2.5	1.7	12.5	103.6	144
09/13/22 15:54	0.1	0.000	0.0	1,053.3	2,635.1	232	0.007	2.6	1.8	12.6	103.7	144
09/13/22 15:55	0.1	0.000	0.0	1,053.3	2,641.5	233	0.007	2.6	1.8	12.5	103.9	144
09/13/22 15:56	0.1	0.000	0.0	1,053.3	2,640.3	232	0.006	2.5	1.8	12.5	103.9	144
09/13/22 15:57	0.1	0.000	0.0	1,053.3	2,645.2	233	0.006	2.5	1.8	12.5	104.1	144
09/13/22 15:58	0.1	0.000	0.0	1,054.1	2,647.4	233	0.006	2.5	1.8	12.5	104.1	144
Average	0.3	0.00	0.0	1052.1	2638.1	232	0.007	2.5	1.8	12.5	103.9	144

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generator

Interval: 1 Minute

Type: Roll

Report Period: 09/14/2022 09:25 Through 09/14/2022 14:43

Time Online Criteria: 1 minute(s)

Source Parameter Unit		UNIT02											
		CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 1													
09/14/22	09:25	0.0	0.000	0.0	1,053.3	2,679.2	240	0.003	1.3	0.9	12.4	105.8	134
09/14/22	09:26	0.0	0.000	0.0	1,053.3	2,690.7	241	0.004	1.4	0.9	12.4	106.3	134
09/14/22	09:27	0.0	0.000	0.0	1,053.3	2,691.6	241	0.004	1.4	1.0	12.4	106.3	134
09/14/22	09:28	0.0	0.000	0.0	1,053.3	2,687.9	241	0.004	1.4	1.0	12.4	106.1	135
09/14/22	09:29	0.0	0.000	0.0	1,053.3	2,690.2	240	0.004	1.5	1.0	12.4	106.2	135
09/14/22	09:30	0.0	0.000	0.0	1,053.3	2,673.3	239	0.004	1.5	1.0	12.4	105.5	135
09/14/22	09:31	0.0	0.000	0.0	1,053.3	2,687.5	240	0.004	1.5	1.0	12.4	106.1	135
09/14/22	09:32	0.0	0.000	0.0	1,053.3	2,687.9	240	0.004	1.5	1.0	12.4	106.1	135
09/14/22	09:33	0.0	0.000	0.0	1,053.3	2,688.5	240	0.004	1.6	1.1	12.4	106.1	135
09/14/22	09:34	0.0	0.000	0.0	1,053.3	2,672.6	239	0.004	1.7	1.2	12.4	105.5	134
09/14/22	09:35	0.0	0.000	0.0	1,053.3	2,685.7	239	0.004	1.7	1.2	12.4	106.0	134
09/14/22	09:36	0.0	0.000	0.0	1,053.3	2,673.5	239	0.004	1.7	1.2	12.4	105.5	134
09/14/22	09:37	0.0	0.000	0.0	1,053.3	2,674.8	239	0.004	1.7	1.2	12.4	105.5	134
09/14/22	09:38	0.0	0.000	0.0	1,053.3	2,677.1	240	0.005	1.8	1.2	12.4	105.6	134
09/14/22	09:39	0.0	0.000	0.0	1,053.3	2,681.1	240	0.005	1.8	1.3	12.4	105.8	134
09/14/22	09:40	0.0	0.000	0.0	1,053.3	2,666.2	239	0.005	1.9	1.3	12.4	105.2	134
09/14/22	09:41	0.0	0.000	0.0	1,053.3	2,678.9	239	0.005	2.0	1.4	12.5	105.7	134
09/14/22	09:42	0.0	0.000	0.0	1,053.3	2,687.7	240	0.005	2.0	1.4	12.4	106.1	134
09/14/22	09:43	0.0	0.000	0.0	1,053.3	2,667.8	238	0.005	2.1	1.4	12.4	105.2	135
09/14/22	09:44	0.0	0.000	0.0	1,053.3	2,684.4	240	0.005	2.1	1.5	12.4	105.9	135
09/14/22	09:45	0.0	0.000	0.0	1,053.3	2,674.1	239	0.005	2.1	1.5	12.4	105.5	134
Average		0.0	0.000	0.0	1,053.3	2,681.0	239	0.005	1.9	1.3	12.4	105.6	134

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/14/2022 09:25 Through 09/14/2022 14:43

Time Online Criteria: 1 minute(s)

Source Parameter Unit	UNIT02											
	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 2												
09/14/22 09:57	0.0	0.000	0.0	1,053.3	2,669.4	239	0.006	2.4	1.7	12.4	105.3	135
09/14/22 09:58	0.0	0.000	0.0	1,053.3	2,676.8	240	0.006	2.4	1.7	12.5	105.6	135
09/14/22 09:59	0.0	0.000	0.0	1,053.3	2,674.1	239	0.006	2.4	1.7	12.4	105.5	134
09/14/22 10:00	0.0	0.000	0.0	1,053.3	2,675.2	238	0.006	2.5	1.7	12.4	105.5	134
09/14/22 10:01	0.0	0.000	0.0	1,053.3	2,679.3	239	0.006	2.5	1.8	12.5	105.7	134
09/14/22 10:02	0.0	0.000	0.0	1,053.3	2,660.6	238	0.006	2.5	1.7	12.4	104.9	134
09/14/22 10:03	0.0	0.000	0.0	1,053.3	2,669.2	239	0.006	2.4	1.7	12.5	105.3	134
09/14/22 10:04	0.0	0.000	0.0	1,053.3	2,679.6	240	0.006	2.4	1.7	12.4	105.7	135
09/14/22 10:05	0.0	0.000	0.0	1,053.3	2,661.4	238	0.006	2.5	1.7	12.4	104.9	135
09/14/22 10:06	0.0	0.000	0.0	1,053.3	2,675.8	239	0.007	2.6	1.8	12.4	105.5	135
09/14/22 10:07	0.0	0.000	0.0	1,053.3	2,665.1	238	0.007	2.6	1.8	12.4	105.1	135
09/14/22 10:08	0.0	0.000	0.0	1,053.3	2,671.9	239	0.006	2.5	1.8	12.4	105.4	135
09/14/22 10:09	0.0	0.000	0.0	1,053.3	2,685.4	239	0.006	2.5	1.7	12.4	105.9	134
09/14/22 10:10	0.0	0.000	0.0	1,053.3	2,666.2	238	0.006	2.5	1.7	12.5	105.1	134
09/14/22 10:11	0.0	0.000	0.0	1,053.3	2,670.3	238	0.006	2.5	1.7	12.5	105.3	134
09/14/22 10:12	0.0	0.000	0.0	1,053.3	2,670.5	238	0.006	2.5	1.8	12.4	105.3	134
09/14/22 10:13	0.0	0.000	0.0	1,053.3	2,668.0	238	0.007	2.6	1.8	12.5	105.2	134
09/14/22 10:14	0.0	0.000	0.0	1,053.3	2,680.1	239	0.007	2.6	1.8	12.5	105.7	135
09/14/22 10:15	0.0	0.000	0.0	1,053.3	2,666.5	238	0.007	2.6	1.8	12.4	105.1	134
09/14/22 10:16	0.0	0.000	0.0	1,053.3	2,675.2	238	0.006	2.5	1.8	12.5	105.5	134
09/14/22 10:17	0.0	0.000	0.0	1,053.3	2,679.3	239	0.006	2.4	1.7	12.5	105.7	134
Average	0.0	0.000	0.0	1,053.3	2,672.4	239	0.006	2.5	1.7	12.4	105.4	134

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/14/2022 09:25 Through 09/14/2022 14:43

Time Online Criteria: 1 minute(s)

Source		UNIT02											
Parameter	Unit	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 3													
09/14/22	10:28	0.0	0.000	0.0	1,053.4	2,676.0	239	0.006	2.4	1.7	12.5	105.5	134
09/14/22	10:29	0.0	0.000	0.0	1,053.4	2,667.0	238	0.006	2.4	1.7	12.4	105.1	134
09/14/22	10:30	0.0	0.000	0.0	1,053.4	2,669.7	238	0.007	2.6	1.8	12.4	105.3	134
09/14/22	10:31	0.0	0.000	0.0	1,053.4	2,658.4	237	0.007	2.8	1.9	12.4	104.8	135
09/14/22	10:32	0.0	0.000	0.0	1,053.4	2,665.9	238	0.007	2.8	1.9	12.5	105.1	135
09/14/22	10:33	0.0	0.000	0.0	1,053.4	2,671.8	239	0.007	2.6	1.8	12.4	105.4	134
09/14/22	10:34	0.0	0.000	0.0	1,053.4	2,672.6	239	0.006	2.4	1.7	12.4	105.4	134
09/14/22	10:35	0.0	0.000	0.0	1,053.4	2,669.5	239	0.006	2.4	1.7	12.4	105.3	134
09/14/22	10:36	0.0	0.000	0.0	1,053.4	2,664.4	238	0.007	2.6	1.8	12.4	105.0	134
09/14/22	10:37	0.0	0.000	0.0	1,053.4	2,676.1	239	0.007	2.7	1.9	12.4	105.5	135
09/14/22	10:38	0.0	0.000	0.0	1,053.4	2,664.0	238	0.007	2.7	1.9	12.4	105.0	135
09/14/22	10:39	0.0	0.000	0.0	1,053.4	2,671.5	238	0.007	2.6	1.8	12.5	105.3	134
09/14/22	10:40	0.0	0.000	0.0	1,053.4	2,662.9	238	0.006	2.4	1.7	12.4	105.0	135
09/14/22	10:41	0.0	0.000	0.0	1,053.4	2,676.1	239	0.006	2.4	1.7	12.4	105.5	135
09/14/22	10:42	0.0	0.000	0.0	1,053.4	2,663.1	237	0.007	2.6	1.8	12.4	105.0	135
09/14/22	10:43	0.0	0.000	0.0	1,053.4	2,670.6	238	0.007	2.7	1.9	12.4	105.3	135
09/14/22	10:44	0.0	0.000	0.0	1,053.4	2,664.6	238	0.007	2.8	1.9	12.5	105.1	135
09/14/22	10:45	0.0	0.000	0.0	1,053.4	2,675.6	239	0.007	2.6	1.8	12.4	105.5	134
09/14/22	10:46	0.0	0.000	0.0	1,053.4	2,668.8	238	0.006	2.5	1.7	12.4	105.2	134
09/14/22	10:47	0.0	0.000	0.0	1,053.4	2,676.5	239	0.006	2.4	1.7	12.5	105.6	135
09/14/22	10:48	0.0	0.000	0.0	1,053.4	2,679.4	239	0.007	2.7	1.9	12.4	105.7	135
Average		0.0	0.000	0.0	1,053.4	2,669.7	238	0.007	2.6	1.8	12.4	105.3	135

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/14/2022 09:25 Through 09/14/2022 14:43

Time Online Criteria: 1 minute(s)

Source Parameter Unit	UNIT02											
	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 4												
09/14/22 11:06	0.0	0.000	0.0	1,053.2	2,666.8	238	0.008	3.2	2.2	12.5	105.2	135
09/14/22 11:07	0.0	0.000	0.0	1,053.2	2,662.7	239	0.007	2.6	1.8	12.4	105.0	135
09/14/22 11:08	0.0	0.000	0.0	1,053.2	2,672.0	239	0.006	2.2	1.6	12.5	105.4	135
09/14/22 11:09	0.0	0.000	0.0	1,053.2	2,664.2	238	0.006	2.4	1.7	12.4	105.1	134
09/14/22 11:10	0.0	0.000	0.0	1,053.2	2,665.1	239	0.007	2.9	2.1	12.4	105.1	134
09/14/22 11:11	0.0	0.000	0.0	1,053.2	2,666.9	239	0.007	2.9	2.0	12.4	105.2	134
09/14/22 11:12	0.0	0.000	0.0	1,053.2	2,674.5	239	0.006	2.2	1.5	12.5	105.5	134
09/14/22 11:13	0.0	0.000	0.0	1,053.2	2,667.0	238	0.006	2.2	1.5	12.5	105.2	134
09/14/22 11:14	0.0	0.000	0.0	1,053.2	2,675.5	239	0.007	2.6	1.8	12.5	105.5	134
09/14/22 11:15	0.0	0.000	0.0	1,053.2	2,674.4	238	0.008	3.3	2.3	12.4	105.5	134
09/14/22 11:16	0.0	0.000	0.0	1,053.2	2,672.3	239	0.006	2.4	1.7	12.5	105.4	134
09/14/22 11:17	0.0	0.000	0.0	1,053.2	2,661.6	238	0.005	2.0	1.4	12.4	105.0	134
09/14/22 11:18	0.0	0.000	0.0	1,053.1	2,669.1	238	0.007	2.6	1.8	12.5	105.3	134
09/14/22 11:19	0.0	0.000	0.0	1,053.1	2,673.0	239	0.008	3.1	2.1	12.4	105.4	134
09/14/22 11:20	0.0	0.000	0.0	1,053.1	2,670.4	238	0.007	2.7	1.9	12.4	105.3	134
09/14/22 11:21	0.0	0.000	0.0	1,053.1	2,669.1	238	0.005	2.1	1.5	12.4	105.3	134
09/14/22 11:22	0.0	0.000	0.0	1,053.1	2,669.1	239	0.006	2.3	1.6	12.5	105.3	134
09/14/22 11:23	0.0	0.000	0.0	1,053.1	2,676.6	239	0.008	3.1	2.2	12.5	105.6	134
09/14/22 11:24	0.0	0.000	0.0	1,053.1	2,671.7	239	0.007	2.9	2.0	12.4	105.4	134
09/14/22 11:25	0.0	0.000	0.0	1,053.1	2,667.9	238	0.005	2.1	1.5	12.5	105.2	134
09/14/22 11:26	0.0	0.000	0.0	1,053.1	2,673.6	239	0.005	2.1	1.5	12.4	105.5	134
Average	0.0	0.000	0.0	1,053.2	2,669.7	239	0.007	2.6	1.8	12.4	105.3	134

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/14/2022 09:25 Through 09/14/2022 14:43

Time Online Criteria: 1 minute(s)

Source Parameter Unit	UNIT02											
	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 5												
09/14/22 11:36	0.0	0.000	0.0	1,053.1	2,664.5	237	0.008	3.0	2.1	12.4	105.1	134
09/14/22 11:37	0.0	0.000	0.0	1,053.1	2,656.2	236	0.007	2.6	1.8	12.5	104.7	134
09/14/22 11:38	0.0	0.000	0.0	1,053.1	2,670.0	238	0.005	2.0	1.4	12.5	105.3	134
09/14/22 11:39	0.0	0.000	0.0	1,053.1	2,661.6	238	0.006	2.4	1.7	12.4	105.0	134
09/14/22 11:40	0.0	0.000	0.0	1,053.1	2,666.7	238	0.009	3.4	2.3	12.4	105.2	134
09/14/22 11:41	0.0	0.000	0.0	1,053.1	2,659.7	238	0.007	2.6	1.8	12.4	104.9	134
09/14/22 11:42	0.0	0.000	0.0	1,053.1	2,662.1	238	0.005	2.1	1.4	12.4	105.0	134
09/14/22 11:43	0.0	0.000	0.0	1,053.1	2,665.1	238	0.006	2.3	1.6	12.4	105.1	134
09/14/22 11:44	0.0	0.000	0.0	1,053.1	2,673.0	238	0.008	3.2	2.2	12.4	105.5	134
09/14/22 11:45	0.0	0.000	0.0	1,053.1	2,661.1	237	0.007	2.9	2.0	12.4	104.9	134
09/14/22 11:46	0.0	0.000	0.0	1,053.1	2,668.6	237	0.005	2.1	1.5	12.5	105.3	134
09/14/22 11:47	0.0	0.000	0.0	1,053.1	2,671.5	238	0.006	2.2	1.5	12.4	105.4	134
09/14/22 11:48	0.0	0.000	0.0	1,053.1	2,658.5	238	0.008	3.2	2.2	12.4	104.8	134
09/14/22 11:49	0.0	0.000	0.0	1,053.1	2,657.8	238	0.007	2.9	2.0	12.4	104.8	134
09/14/22 11:50	0.0	0.000	0.0	1,053.1	2,672.1	238	0.005	2.1	1.4	12.4	105.4	134
09/14/22 11:51	0.0	0.000	0.0	1,053.1	2,663.5	237	0.006	2.2	1.5	12.4	105.0	134
09/14/22 11:52	0.0	0.000	0.0	1,053.1	2,659.2	238	0.008	3.0	2.1	12.4	104.9	134
09/14/22 11:53	0.0	0.000	0.0	1,053.1	2,671.2	238	0.008	3.1	2.1	12.4	105.4	134
09/14/22 11:54	0.0	0.000	0.0	1,053.1	2,667.4	238	0.006	2.2	1.5	12.5	105.2	134
09/14/22 11:55	0.0	0.000	0.0	1,053.1	2,659.8	238	0.005	2.1	1.5	12.4	104.9	134
09/14/22 11:56	0.0	0.000	0.0	1,053.1	2,656.7	238	0.008	2.9	2.1	12.5	104.8	134
Average	0.0	0.000	0.0	1,053.1	2,664.1	238	0.007	2.6	1.8	12.4	105.1	134

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/14/2022 09:25 Through 09/14/2022 14:43

Time Online Criteria: 1 minute(s)

Source Parameter Unit		UNIT02											
		CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 6													
09/14/22	12:07	0.0	0.000	0.0	1,052.9	2,659.6	237	0.006	2.2	1.5	12.4	104.9	134
09/14/22	12:08	0.0	0.000	0.0	1,052.9	2,667.9	238	0.006	2.2	1.5	12.5	105.3	134
09/14/22	12:09	0.0	0.000	0.0	1,052.9	2,665.0	238	0.007	2.9	2.0	12.4	105.1	134
09/14/22	12:10	0.0	0.000	0.0	1,052.9	2,657.8	238	0.008	3.2	2.2	12.5	104.8	134
09/14/22	12:11	0.0	0.000	0.0	1,052.8	2,658.3	237	0.006	2.3	1.6	12.4	104.9	134
09/14/22	12:12	0.0	0.000	0.0	1,052.8	2,666.7	238	0.005	2.1	1.5	12.5	105.2	134
09/14/22	12:13	0.0	0.000	0.0	1,052.8	2,666.1	237	0.007	2.8	1.9	12.5	105.2	134
09/14/22	12:14	0.0	0.000	0.0	1,052.8	2,662.0	238	0.008	3.0	2.1	12.4	105.0	134
09/14/22	12:15	0.0	0.000	0.0	1,052.8	2,662.0	237	0.007	2.6	1.8	12.4	105.0	134
09/14/22	12:16	0.0	0.000	0.0	1,052.8	2,668.4	238	0.005	2.0	1.4	12.5	105.3	134
09/14/22	12:17	0.0	0.000	0.0	1,052.8	2,665.4	237	0.006	2.5	1.7	12.5	105.2	134
09/14/22	12:18	0.0	0.000	0.0	1,052.8	2,669.4	238	0.009	3.3	2.3	12.5	105.3	134
09/14/22	12:19	0.0	0.000	0.0	1,052.8	2,668.6	238	0.007	2.7	1.9	12.5	105.3	134
09/14/22	12:20	0.0	0.000	0.0	1,052.8	2,662.8	237	0.005	2.0	1.4	12.5	105.0	134
09/14/22	12:21	0.0	0.000	0.0	1,052.8	2,661.6	237	0.006	2.2	1.6	12.5	105.0	134
09/14/22	12:22	0.0	0.000	0.0	1,052.8	2,675.1	238	0.008	3.1	2.2	12.5	105.6	134
09/14/22	12:23	0.0	0.000	0.0	1,052.8	2,660.9	237	0.008	3.1	2.1	12.4	105.0	134
09/14/22	12:24	0.0	0.000	0.0	1,052.7	2,653.8	238	0.006	2.2	1.5	12.5	104.7	134
09/14/22	12:25	0.0	0.000	0.0	1,052.7	2,659.7	237	0.005	2.0	1.4	12.5	104.9	134
09/14/22	12:26	0.0	0.000	0.0	1,052.7	2,661.8	237	0.007	2.7	1.9	12.5	105.0	134
09/14/22	12:27	0.0	0.000	0.0	1,052.7	2,659.0	237	0.009	3.3	2.3	12.5	104.9	134
Average		0.0	0.000	0.0	1,052.8	2,663.4	237	0.007	2.6	1.8	12.5	105.1	134

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generator

Interval: 1 Minute

Type: Roll

Report Period: 09/14/2022 09:25 Through 09/14/2022 14:43

Time Online Criteria: 1 minute(s)

Source Parameter Unit		UNIT02											
		CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 7													
09/14/22	12:44	0.0	0.000	0.0	1,052.6	2,672.0	238	0.008	3.2	2.3	12.5	105.5	134
09/14/22	12:45	0.0	0.000	0.0	1,052.6	2,659.9	238	0.006	2.5	1.7	12.5	104.9	134
09/14/22	12:46	0.0	0.000	0.0	1,052.6	2,663.4	237	0.005	2.1	1.4	12.4	105.1	134
09/14/22	12:47	0.0	0.000	0.0	1,052.6	2,662.5	237	0.006	2.4	1.7	12.4	105.0	134
09/14/22	12:48	0.0	0.000	0.0	1,052.5	2,659.0	237	0.008	3.2	2.2	12.4	104.9	134
09/14/22	12:49	0.0	0.000	0.0	1,052.5	2,672.0	238	0.007	2.7	1.9	12.5	105.5	134
09/14/22	12:50	0.0	0.000	0.0	1,052.5	2,669.4	238	0.005	2.1	1.5	12.5	105.4	134
09/14/22	12:51	0.0	0.000	0.0	1,052.5	2,667.0	238	0.006	2.4	1.6	12.4	105.2	134
09/14/22	12:52	0.0	0.000	0.0	1,052.5	2,657.7	237	0.008	3.2	2.2	12.5	104.9	134
09/14/22	12:53	0.0	0.000	0.0	1,052.5	2,665.6	238	0.006	2.5	1.8	12.5	105.2	134
09/14/22	12:54	0.0	0.000	0.0	1,052.5	2,656.6	237	0.005	2.1	1.4	12.5	104.8	134
09/14/22	12:55	0.0	0.000	0.0	1,052.5	2,661.3	237	0.006	2.2	1.5	12.5	105.0	134
09/14/22	12:56	0.0	0.000	0.0	1,052.5	2,671.1	238	0.008	3.1	2.2	12.4	105.4	134
09/14/22	12:57	0.0	0.000	0.0	1,052.5	2,660.0	238	0.008	3.1	2.2	12.5	105.0	134
09/14/22	12:58	0.0	0.000	0.0	1,052.5	2,659.5	237	0.005	2.1	1.5	12.5	104.9	134
09/14/22	12:59	0.0	0.000	0.0	1,052.5	2,664.7	238	0.005	2.0	1.4	12.5	105.1	134
09/14/22	13:00	0.0	0.000	0.0	1,052.4	2,670.2	238	0.008	3.0	2.1	12.5	105.4	134
09/14/22	13:01	0.0	0.000	0.0	1,052.4	2,663.5	238	0.008	3.1	2.2	12.5	105.1	134
09/14/22	13:02	0.0	0.000	0.0	1,052.4	2,668.4	238	0.005	2.1	1.5	12.5	105.3	134
09/14/22	13:03	0.0	0.000	0.0	1,052.4	2,670.8	238	0.005	2.1	1.5	12.5	105.4	134
09/14/22	13:04	0.0	0.000	0.0	1,052.4	2,659.7	238	0.008	2.9	2.1	12.5	105.0	134
Average		0.0	0.000	0.0	1,052.5	2,664.5	238	0.006	2.6	1.8	12.5	105.1	134

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/14/2022 09:25 Through 09/14/2022 14:43

Time Online Criteria: 1 minute(s)

Source Parameter Unit	UNIT02											
	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 8												
09/14/22 13:16	0.0	0.000	0.0	1,052.2	2,676.9	238	0.007	2.7	1.9	12.5	105.7	134
09/14/22 13:17	0.0	0.000	0.0	1,052.2	2,664.6	238	0.007	2.9	2.1	12.4	105.2	134
09/14/22 13:18	0.0	0.000	0.0	1,052.1	2,654.2	236	0.007	2.7	1.9	12.5	104.7	134
09/14/22 13:19	0.0	0.000	0.0	1,052.1	2,663.1	237	0.005	2.0	1.4	12.5	105.1	134
09/14/22 13:20	0.0	0.000	0.0	1,052.1	2,662.1	237	0.006	2.3	1.6	12.5	105.1	134
09/14/22 13:21	0.0	0.000	0.0	1,052.1	2,664.2	238	0.008	3.2	2.2	12.5	105.2	134
09/14/22 13:22	0.0	0.000	0.0	1,052.1	2,664.9	237	0.008	2.9	2.0	12.5	105.2	134
09/14/22 13:23	0.0	0.000	0.0	1,052.0	2,659.3	237	0.006	2.2	1.5	12.5	105.0	134
09/14/22 13:24	0.0	0.000	0.0	1,051.9	2,665.5	237	0.005	2.1	1.5	12.5	105.2	134
09/14/22 13:25	0.0	0.000	0.0	1,051.9	2,661.4	237	0.008	2.9	2.0	12.5	105.1	134
09/14/22 13:26	0.0	0.000	0.0	1,051.9	2,662.5	237	0.008	3.1	2.2	12.5	105.1	134
09/14/22 13:27	0.0	0.000	0.0	1,051.9	2,684.3	239	0.006	2.2	1.5	12.5	106.0	134
09/14/22 13:28	0.0	0.000	0.0	1,051.9	2,662.6	237	0.005	2.1	1.5	12.5	105.1	134
09/14/22 13:29	0.0	0.000	0.0	1,051.9	2,669.2	238	0.007	2.7	1.9	12.5	105.4	134
09/14/22 13:30	0.0	0.000	0.0	1,051.8	2,662.2	237	0.008	3.2	2.3	12.5	105.1	134
09/14/22 13:31	0.0	0.000	0.0	1,051.8	2,658.7	236	0.006	2.4	1.7	12.5	105.0	134
09/14/22 13:32	0.0	0.000	0.0	1,051.8	2,662.9	237	0.005	2.0	1.4	12.5	105.1	134
09/14/22 13:33	0.0	0.000	0.0	1,051.8	2,659.2	237	0.007	2.6	1.8	12.5	105.0	134
09/14/22 13:34	0.0	0.000	0.0	1,051.8	2,658.1	237	0.009	3.3	2.3	12.5	104.9	134
09/14/22 13:35	0.0	0.000	0.0	1,051.8	2,658.4	237	0.006	2.5	1.8	12.5	104.9	134
09/14/22 13:36	0.0	0.000	0.0	1,051.6	2,657.5	236	0.005	2.0	1.4	12.5	104.9	134
Average	0.0	0.000	0.0	1,051.9	2,663.4	237	0.007	2.6	1.8	12.5	105.1	134

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/14/2022 09:25 Through 09/14/2022 14:43

Time Online Criteria: 1 minute(s)

Source Parameter Unit	UNIT02											
	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 9												
09/14/22 13:46	0.0	0.000	0.0	1,051.4	2,671.6	238	0.008	3.1	2.2	12.5	105.6	134
09/14/22 13:47	0.0	0.000	0.0	1,051.4	2,653.4	236	0.007	2.8	2.0	12.5	104.8	134
09/14/22 13:48	0.0	0.000	0.0	1,051.3	2,671.9	239	0.005	1.9	1.4	12.5	105.6	134
09/14/22 13:49	0.0	0.000	0.0	1,051.3	2,674.2	238	0.006	2.4	1.7	12.5	105.7	134
09/14/22 13:50	0.0	0.000	0.0	1,051.3	2,675.6	239	0.009	3.4	2.4	12.5	105.7	134
09/14/22 13:51	0.0	0.000	0.0	1,051.3	2,659.9	237	0.007	2.7	1.9	12.5	105.1	134
09/14/22 13:52	0.0	0.000	0.0	1,051.3	2,676.7	239	0.005	2.0	1.4	12.5	105.8	135
09/14/22 13:53	0.0	0.000	0.0	1,051.3	2,674.1	238	0.006	2.3	1.6	12.5	105.7	135
09/14/22 13:54	0.0	0.000	0.0	1,051.2	2,665.7	238	0.008	3.1	2.2	12.5	105.3	135
09/14/22 13:55	0.0	0.000	0.0	1,051.2	2,671.0	238	0.007	2.7	1.9	12.5	105.6	135
09/14/22 13:56	0.0	0.000	0.0	1,051.2	2,672.4	238	0.005	2.1	1.5	12.5	105.6	135
09/14/22 13:57	0.0	0.000	0.0	1,051.2	2,678.7	239	0.006	2.2	1.5	12.5	105.9	135
09/14/22 13:58	0.0	0.000	0.0	1,051.2	2,670.8	238	0.008	2.9	2.1	12.5	105.5	135
09/14/22 13:59	0.0	0.000	0.0	1,051.2	2,674.8	238	0.008	3.0	2.1	12.5	105.7	135
09/14/22 14:00	0.0	0.000	0.0	1,051.1	2,675.4	238	0.006	2.2	1.5	12.5	105.8	135
09/14/22 14:01	0.0	0.000	0.0	1,051.1	2,666.5	237	0.005	2.1	1.5	12.5	105.4	135
09/14/22 14:02	0.0	0.000	0.0	1,051.1	2,665.9	238	0.007	2.7	1.9	12.5	105.3	135
09/14/22 14:03	0.0	0.000	0.0	1,051.1	2,667.3	238	0.008	3.1	2.2	12.5	105.4	135
09/14/22 14:04	0.0	0.000	0.0	1,051.1	2,674.2	238	0.006	2.4	1.7	12.5	105.7	135
09/14/22 14:05	0.0	0.000	0.0	1,051.1	2,661.4	237	0.005	2.1	1.5	12.5	105.2	135
09/14/22 14:06	0.0	0.000	0.0	1,051.0	2,666.3	238	0.006	2.5	1.7	12.5	105.4	135
Average	0.0	0.000	0.0	1,051.2	2,669.9	238	0.007	2.6	1.8	12.5	105.5	135

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/14/2022 09:25 Through 09/14/2022 14:43

Time Online Criteria: 1 minute(s)

Source Parameter Unit	UNIT02											
	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run												
10												
09/14/22 14:23	0.0	0.000	0.0	1,050.7	2,663.6	238	0.006	2.4	1.7	12.5	105.3	135
09/14/22 14:24	0.0	0.000	0.0	1,050.6	2,675.9	239	0.008	3.0	2.1	12.5	105.8	135
09/14/22 14:25	0.0	0.000	0.0	1,050.6	2,664.2	237	0.008	2.9	2.0	12.5	105.3	135
09/14/22 14:26	0.0	0.000	0.0	1,050.6	2,672.4	239	0.005	2.1	1.5	12.5	105.7	135
09/14/22 14:27	0.0	0.000	0.0	1,050.6	2,667.4	237	0.006	2.2	1.6	12.4	105.5	135
09/14/22 14:28	0.0	0.000	0.0	1,050.6	2,667.3	238	0.008	3.0	2.1	12.5	105.5	135
09/14/22 14:29	0.0	0.000	0.0	1,050.6	2,667.1	238	0.008	2.9	2.0	12.5	105.4	135
09/14/22 14:30	0.0	0.000	0.0	1,050.6	2,669.1	237	0.006	2.2	1.5	12.5	105.5	135
09/14/22 14:31	0.0	0.000	0.0	1,050.5	2,664.5	237	0.006	2.2	1.5	12.5	105.3	135
09/14/22 14:32	0.0	0.000	0.0	1,050.5	2,667.0	237	0.008	2.9	2.1	12.5	105.5	134
09/14/22 14:33	0.0	0.000	0.0	1,050.5	2,673.6	237	0.008	2.9	2.0	12.5	105.7	134
09/14/22 14:34	0.0	0.000	0.0	1,050.5	2,666.1	237	0.007	2.6	1.8	12.5	105.4	134
09/14/22 14:35	0.0	0.000	0.0	1,050.5	2,661.6	237	0.006	2.2	1.5	12.5	105.2	134
09/14/22 14:36	0.0	0.000	0.0	1,050.5	2,667.8	238	0.006	2.3	1.6	12.5	105.5	134
09/14/22 14:37	0.0	0.000	0.0	1,050.5	2,661.7	238	0.008	3.0	2.1	12.5	105.2	134
09/14/22 14:38	0.0	0.000	0.0	1,050.5	2,664.9	237	0.008	2.9	2.1	12.5	105.4	134
09/14/22 14:39	0.0	0.000	0.0	1,050.5	2,666.5	238	0.006	2.2	1.5	12.5	105.4	134
09/14/22 14:40	0.0	0.000	0.0	1,050.5	2,659.2	238	0.005	2.1	1.5	12.5	105.1	134
09/14/22 14:41	0.0	0.000	0.0	1,050.5	2,661.4	238	0.007	2.7	1.9	12.5	105.2	134
09/14/22 14:42	0.0	0.000	0.0	1,050.5	2,662.6	237	0.009	3.3	2.3	12.5	105.3	134
09/14/22 14:43	0.0	0.000	0.0	1,050.4	2,659.9	237	0.006	2.4	1.7	12.5	105.2	134
Average	0	0	0	1050.5	2665.9	238	0.007	2.6	1.8	12.5	105.4	134

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/15/2022 09:13 Through 09/15/2022 14:27

Time Online Criteria: 1 minute(s)

Source		UNIT03											
Parameter Unit		CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run1													
09/15/22	09:13	5.5	0.002	1.3	1,086.1	2,686.3	245	0.007	2.5	1.8	12.7	106.1	143
09/15/22	09:14	5.4	0.002	1.2	1,086.1	2,670.5	244	0.006	2.4	1.7	12.8	105.4	143
09/15/22	09:15	5.4	0.002	1.2	1,086.1	2,676.6	244	0.006	2.3	1.7	12.8	105.7	142
09/15/22	09:16	5.3	0.002	1.2	1,086.1	2,677.6	244	0.006	2.3	1.7	12.8	105.7	142
09/15/22	09:17	5.2	0.002	1.2	1,086.1	2,675.0	244	0.006	2.4	1.7	12.8	105.6	142
09/15/22	09:18	4.9	0.002	1.1	1,086.1	2,680.8	244	0.006	2.4	1.8	12.8	105.9	142
09/15/22	09:19	5.0	0.002	1.1	1,086.0	2,676.3	244	0.006	2.4	1.8	12.8	105.7	142
09/15/22	09:20	4.8	0.002	1.1	1,086.0	2,672.5	244	0.006	2.4	1.8	12.8	105.5	142
09/15/22	09:21	5.2	0.002	1.2	1,086.0	2,676.4	244	0.006	2.4	1.8	12.8	105.7	142
09/15/22	09:22	5.0	0.002	1.1	1,086.0	2,676.7	244	0.006	2.4	1.8	12.8	105.7	142
09/15/22	09:23	5.0	0.002	1.2	1,086.0	2,668.6	244	0.007	2.5	1.8	12.8	105.4	141
09/15/22	09:24	5.4	0.002	1.2	1,086.1	2,670.2	244	0.007	2.5	1.8	12.8	105.4	141
09/15/22	09:25	5.1	0.002	1.2	1,086.1	2,677.4	244	0.007	2.5	1.8	12.8	105.7	141
09/15/22	09:26	5.5	0.002	1.3	1,086.1	2,668.9	243	0.007	2.5	1.8	12.8	105.4	141
09/15/22	09:27	5.6	0.002	1.3	1,086.1	2,674.9	244	0.006	2.4	1.8	12.8	105.6	141
09/15/22	09:28	5.8	0.002	1.3	1,086.1	2,668.7	243	0.007	2.5	1.8	12.8	105.4	141
09/15/22	09:29	5.4	0.002	1.2	1,086.1	2,669.6	243	0.007	2.5	1.8	12.8	105.4	141
09/15/22	09:30	5.1	0.002	1.2	1,086.1	2,669.0	243	0.007	2.5	1.8	12.8	105.4	141
09/15/22	09:31	5.3	0.002	1.2	1,086.1	2,670.0	243	0.007	2.5	1.8	12.8	105.4	141
09/15/22	09:32	5.1	0.002	1.2	1,086.1	2,666.9	243	0.007	2.5	1.8	12.8	105.3	141
09/15/22	09:33	5.2	0.002	1.2	1,086.1	2,670.0	244	0.006	2.4	1.8	12.8	105.4	141
Average		5.2	0.002	1.2	1,086.1	2,673.5	244	0.006	2.4	1.8	12.8	105.6	142

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/15/2022 09:13 Through 09/15/2022 14:27

Time Online Criteria: 1 minute(s)

Source		UNIT03										
Parameter Unit	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 2												
09/15/22 09:44	5.4	0.002	1.2	1,086.5	2,661.7	243	0.007	2.5	1.8	12.8	105.0	141
09/15/22 09:45	5.9	0.002	1.4	1,086.5	2,661.6	243	0.007	2.5	1.8	12.8	105.0	141
09/15/22 09:46	5.5	0.002	1.3	1,086.5	2,656.9	242	0.006	2.4	1.8	12.8	104.8	141
09/15/22 09:47	5.6	0.002	1.3	1,086.5	2,660.5	242	0.006	2.4	1.8	12.8	105.0	141
09/15/22 09:48	5.1	0.002	1.2	1,086.5	2,663.0	243	0.006	2.4	1.8	12.8	105.1	141
09/15/22 09:49	5.1	0.002	1.2	1,086.7	2,661.3	242	0.007	2.5	1.8	12.8	105.0	141
09/15/22 09:50	5.1	0.002	1.2	1,086.7	2,658.6	242	0.007	2.5	1.8	12.8	104.9	141
09/15/22 09:51	4.9	0.002	1.1	1,086.7	2,662.3	242	0.007	2.5	1.8	12.8	105.0	141
09/15/22 09:52	4.7	0.002	1.1	1,086.7	2,661.8	242	0.006	2.4	1.8	12.8	105.0	141
09/15/22 09:53	4.5	0.002	1.0	1,086.7	2,660.6	242	0.007	2.5	1.8	12.8	105.0	141
09/15/22 09:54	4.6	0.002	1.1	1,086.8	2,658.6	242	0.007	2.5	1.8	12.8	104.9	141
09/15/22 09:55	5.1	0.002	1.2	1,086.9	2,660.8	242	0.007	2.5	1.8	12.8	104.9	141
09/15/22 09:56	5.3	0.002	1.2	1,086.9	2,666.7	242	0.007	2.5	1.8	12.8	105.2	141
09/15/22 09:57	5.2	0.002	1.2	1,086.9	2,656.4	242	0.007	2.5	1.8	12.8	104.7	141
09/15/22 09:58	5.3	0.002	1.2	1,086.9	2,662.5	242	0.006	2.4	1.8	12.8	105.0	141
09/15/22 09:59	5.6	0.002	1.3	1,086.9	2,663.3	242	0.007	2.5	1.8	12.8	105.0	141
09/15/22 10:00	5.9	0.002	1.4	1,086.9	2,657.7	242	0.007	2.5	1.8	12.8	104.8	141
09/15/22 10:01	5.4	0.002	1.2	1,086.9	2,664.5	242	0.006	2.4	1.8	12.8	105.1	141
09/15/22 10:02	5.2	0.002	1.2	1,086.9	2,659.1	242	0.007	2.5	1.8	12.8	104.9	141
09/15/22 10:03	5.5	0.002	1.3	1,086.9	2,659.2	242	0.007	2.5	1.8	12.8	104.9	141
09/15/22 10:04	6.1	0.002	1.4	1,086.9	2,660.5	242	0.007	2.5	1.8	12.8	104.9	141
Average	5.3	0.002	1.2	1,086.8	2,660.8	242	0.007	2.5	1.8	12.8	105.0	141

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/15/2022 09:13 Through 09/15/2022 14:27

Time Online Criteria: 1 minute(s)

Source		UNIT03											
Parameter	Unit	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 3													
09/15/22	10:15	5.5	0.002	1.3	1,086.6	2,656.3	242	0.006	2.4	1.7	12.8	104.8	141
09/15/22	10:16	5.6	0.002	1.3	1,086.6	2,657.9	242	0.006	2.4	1.8	12.8	104.8	141
09/15/22	10:17	5.5	0.002	1.3	1,086.6	2,656.3	242	0.007	2.5	1.8	12.8	104.8	141
09/15/22	10:18	5.7	0.002	1.3	1,086.6	2,649.3	241	0.007	2.5	1.8	12.8	104.5	141
09/15/22	10:19	5.6	0.002	1.3	1,086.5	2,655.0	241	0.007	2.5	1.8	12.8	104.7	141
09/15/22	10:20	5.2	0.002	1.2	1,086.5	2,649.5	241	0.007	2.5	1.8	12.8	104.5	141
09/15/22	10:21	5.4	0.002	1.2	1,086.5	2,648.5	241	0.007	2.5	1.8	12.8	104.5	141
09/15/22	10:22	5.6	0.002	1.3	1,086.5	2,650.9	241	0.006	2.4	1.8	12.8	104.6	141
09/15/22	10:23	5.6	0.002	1.3	1,086.5	2,647.7	241	0.006	2.4	1.8	12.8	104.4	141
09/15/22	10:24	5.1	0.002	1.2	1,086.4	2,647.3	241	0.006	2.4	1.8	12.8	104.4	141
09/15/22	10:25	5.4	0.002	1.3	1,086.4	2,650.1	241	0.007	2.5	1.8	12.8	104.5	141
09/15/22	10:26	5.0	0.002	1.2	1,086.4	2,643.8	241	0.007	2.6	1.9	12.8	104.3	141
09/15/22	10:27	4.3	0.002	1.0	1,086.4	2,652.1	241	0.007	2.6	1.9	12.8	104.6	141
09/15/22	10:28	4.6	0.002	1.1	1,086.4	2,649.1	241	0.007	2.5	1.8	12.8	104.5	141
09/15/22	10:29	4.6	0.002	1.1	1,086.4	2,644.7	241	0.006	2.4	1.8	12.8	104.3	141
09/15/22	10:30	4.9	0.002	1.1	1,086.4	2,640.1	240	0.006	2.4	1.7	12.8	104.1	141
09/15/22	10:31	4.9	0.002	1.1	1,086.5	2,649.8	241	0.006	2.4	1.8	12.8	104.5	141
09/15/22	10:32	5.4	0.002	1.2	1,086.5	2,646.0	241	0.007	2.5	1.9	12.8	104.3	141
09/15/22	10:33	5.7	0.002	1.3	1,086.5	2,645.3	241	0.007	2.6	1.9	12.8	104.3	141
09/15/22	10:34	5.5	0.002	1.3	1,086.5	2,648.1	241	0.007	2.5	1.8	12.8	104.4	141
09/15/22	10:35	5.6	0.002	1.3	1,086.5	2,647.2	241	0.007	2.5	1.8	12.8	104.4	141
Average		5.3	0.002	1.2	1,086.5	2,649.3	241	0.007	2.5	1.8	12.8	104.5	141

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/15/2022 09:13 Through 09/15/2022 14:27

Time Online Criteria: 1 minute(s)

Source	UNIT03											
Parameter Unit	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)

Run 4

09/15/22	10:52	5.5	0.002	1.3	1,087.0	2,643.3	240	0.007	2.5	1.8	12.8	104.2	141
09/15/22	10:53	5.2	0.002	1.2	1,087.0	2,635.7	239	0.007	2.6	1.9	12.8	103.9	141
09/15/22	10:54	5.8	0.002	1.4	1,086.9	2,640.3	240	0.007	2.6	1.9	12.8	104.1	141
09/15/22	10:55	5.7	0.002	1.3	1,086.9	2,637.8	240	0.007	2.5	1.8	12.8	104.0	141
09/15/22	10:56	5.5	0.002	1.3	1,086.9	2,634.3	239	0.006	2.4	1.8	12.8	103.8	141
09/15/22	10:57	5.1	0.002	1.2	1,086.9	2,636.7	240	0.006	2.4	1.7	12.8	103.9	141
09/15/22	10:58	5.3	0.002	1.2	1,086.9	2,632.6	239	0.007	2.5	1.8	12.8	103.8	141
09/15/22	10:59	5.1	0.002	1.2	1,086.9	2,634.6	239	0.007	2.5	1.8	12.8	103.8	141
09/15/22	11:00	4.8	0.002	1.1	1,086.8	2,634.8	239	0.008	2.8	2.0	12.8	103.9	141
09/15/22	11:01	5.0	0.002	1.2	1,086.8	2,634.7	239	0.007	2.5	1.8	12.8	103.9	140
09/15/22	11:02	4.9	0.002	1.1	1,086.8	2,631.3	239	0.006	2.4	1.7	12.8	103.7	140
09/15/22	11:03	4.9	0.002	1.1	1,086.8	2,627.2	238	0.006	2.3	1.7	12.8	103.5	140
09/15/22	11:04	4.4	0.002	1.0	1,086.8	2,637.5	239	0.007	2.5	1.8	12.8	104.0	140
09/15/22	11:05	4.5	0.002	1.1	1,086.8	2,630.5	239	0.007	2.7	1.9	12.8	103.7	140
09/15/22	11:06	5.2	0.002	1.2	1,086.8	2,626.4	239	0.007	2.5	1.8	12.8	103.5	140
09/15/22	11:07	5.3	0.002	1.2	1,086.7	2,634.2	239	0.006	2.4	1.7	12.8	103.8	140
09/15/22	11:08	5.8	0.002	1.4	1,086.7	2,623.8	238	0.006	2.4	1.7	12.8	103.4	140
09/15/22	11:09	5.3	0.002	1.2	1,086.7	2,625.8	239	0.006	2.4	1.8	12.8	103.5	140
09/15/22	11:10	5.5	0.002	1.3	1,086.7	2,631.5	239	0.007	2.6	1.9	12.8	103.7	140
09/15/22	11:11	5.3	0.002	1.2	1,086.7	2,626.5	238	0.007	2.6	1.9	12.8	103.5	140
09/15/22	11:12	5.7	0.002	1.3	1,086.7	2,622.2	238	0.007	2.5	1.8	12.8	103.3	140
Average		5.2	0.002	1.2	1,086.8	2,632.5	239	0.007	2.5	1.8	12.8	103.8	140

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/15/2022 09:13 Through 09/15/2022 14:27

Time Online Criteria: 1 minute(s)

Source	UNIT03											
Parameter Unit	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)

Run 5													
09/15/22	11:23	4.9	0.002	1.1	1,086.8	2,615.3	237	0.007	2.6	1.9	12.8	103.0	140
09/15/22	11:24	5.4	0.002	1.3	1,086.9	2,612.6	237	0.007	2.6	1.9	12.8	102.9	140
09/15/22	11:25	5.6	0.002	1.3	1,086.9	2,613.6	237	0.007	2.5	1.8	12.8	103.0	140
09/15/22	11:26	5.6	0.002	1.3	1,086.9	2,615.7	237	0.006	2.4	1.8	12.8	103.1	140
09/15/22	11:27	5.5	0.002	1.3	1,086.9	2,612.5	237	0.006	2.4	1.7	12.8	102.9	140
09/15/22	11:28	5.3	0.002	1.2	1,086.9	2,624.3	238	0.007	2.5	1.8	12.8	103.4	140
09/15/22	11:29	5.6	0.002	1.3	1,086.9	2,613.9	237	0.007	2.6	1.9	12.8	103.0	140
09/15/22	11:30	5.8	0.002	1.3	1,086.9	2,616.9	237	0.007	2.5	1.8	12.8	103.1	140
09/15/22	11:31	5.9	0.002	1.4	1,087.0	2,610.6	237	0.006	2.4	1.7	12.8	102.8	140
09/15/22	11:32	5.5	0.002	1.3	1,087.0	2,606.3	236	0.007	2.5	1.8	12.8	102.7	140
09/15/22	11:33	5.5	0.002	1.3	1,087.0	2,615.3	237	0.007	2.5	1.8	12.8	103.0	140
09/15/22	11:34	5.2	0.002	1.2	1,087.0	2,608.0	236	0.007	2.6	1.9	12.8	102.7	140
09/15/22	11:35	5.2	0.002	1.2	1,087.0	2,616.0	237	0.007	2.6	1.9	12.8	103.1	140
09/15/22	11:36	5.1	0.002	1.2	1,087.1	2,608.5	236	0.007	2.5	1.8	12.8	102.7	140
09/15/22	11:37	4.9	0.002	1.1	1,087.1	2,612.4	237	0.006	2.4	1.8	12.8	102.9	140
09/15/22	11:38	4.9	0.002	1.1	1,087.1	2,607.7	236	0.006	2.4	1.8	12.8	102.7	140
09/15/22	11:39	4.7	0.002	1.1	1,087.1	2,612.3	236	0.006	2.4	1.8	12.8	102.9	140
09/15/22	11:40	4.7	0.002	1.1	1,087.1	2,608.8	236	0.007	2.5	1.8	12.8	102.8	140
09/15/22	11:41	5.0	0.002	1.2	1,087.1	2,603.1	236	0.007	2.5	1.8	12.8	102.5	140
09/15/22	11:42	5.5	0.002	1.3	1,087.1	2,608.5	236	0.007	2.5	1.9	12.8	102.8	140
09/15/22	11:43	5.8	0.002	1.4	1,087.1	2,610.1	236	0.007	2.6	1.9	12.8	102.8	140
Average		4.9	0.002	1.2	1,087.0	2,612.0	237	0.007	2.5	1.8	12.8	102.9	140

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/15/2022 09:13 Through 09/15/2022 14:27

Time Online Criteria: 1 minute(s)

Source	UNIT03											
	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 6												
09/15/22 11:54	5.0	0.002	1.2	1,087.1	2,597.0	235	0.006	2.4	1.8	12.8	102.3	139
09/15/22 11:55	5.1	0.002	1.2	1,087.1	2,604.6	235	0.007	2.5	1.8	12.8	102.6	139
09/15/22 11:56	4.7	0.002	1.1	1,087.1	2,591.3	234	0.007	2.7	1.9	12.8	102.0	140
09/15/22 11:57	4.6	0.002	1.1	1,087.1	2,598.6	235	0.007	2.6	1.9	12.8	102.4	139
09/15/22 11:58	4.6	0.002	1.1	1,087.1	2,599.0	235	0.007	2.6	1.9	12.8	102.4	139
09/15/22 11:59	4.9	0.002	1.2	1,087.1	2,590.2	234	0.007	2.5	1.8	12.8	102.0	139
09/15/22 12:00	5.2	0.002	1.2	1,087.1	2,603.8	236	0.006	2.4	1.8	12.8	102.6	139
09/15/22 12:01	5.5	0.002	1.3	1,087.2	2,591.6	234	0.006	2.4	1.8	12.8	102.1	139
09/15/22 12:02	5.6	0.002	1.3	1,087.2	2,598.1	235	0.006	2.4	1.8	12.8	102.3	139
09/15/22 12:03	5.8	0.002	1.4	1,087.2	2,602.0	235	0.006	2.4	1.7	12.8	102.5	139
09/15/22 12:04	5.6	0.002	1.3	1,087.2	2,599.6	235	0.007	2.5	1.8	12.8	102.4	139
09/15/22 12:05	5.9	0.002	1.4	1,087.2	2,601.0	235	0.007	2.5	1.8	12.8	102.4	139
09/15/22 12:06	5.4	0.002	1.3	1,087.2	2,595.7	235	0.007	2.5	1.8	12.8	102.2	139
09/15/22 12:07	5.6	0.002	1.3	1,087.3	2,591.5	234	0.007	2.5	1.8	12.8	102.0	139
09/15/22 12:08	5.2	0.002	1.2	1,087.3	2,590.9	235	0.007	2.5	1.8	12.8	102.0	139
09/15/22 12:09	5.1	0.002	1.2	1,087.3	2,584.2	234	0.007	2.5	1.8	12.8	101.7	139
09/15/22 12:10	5.3	0.002	1.3	1,087.3	2,589.9	234	0.007	2.6	1.9	12.8	102.0	139
09/15/22 12:11	4.9	0.002	1.2	1,087.3	2,583.5	234	0.007	2.6	1.9	12.8	101.7	139
09/15/22 12:12	5.0	0.002	1.2	1,087.3	2,586.3	234	0.007	2.6	1.9	12.8	101.8	139
09/15/22 12:13	5.1	0.002	1.2	1,087.3	2,593.3	234	0.007	2.5	1.8	12.8	102.1	139
09/15/22 12:14	5.1	0.002	1.2	1,087.3	2,589.0	234	0.007	2.5	1.8	12.8	101.9	139
Average	5.2	0.002	1.2	1,087.2	2,594.3	235	0.007	2.5	1.8	12.8	102.2	139

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/15/2022 09:13 Through 09/15/2022 14:27

Time Online Criteria: 1 minute(s)

Source	UNIT03											
	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run 7												
09/15/22 12:29	4.8	0.002	1.1	1,087.3	2,592.3	234	0.007	2.5	1.8	12.8	102.1	139
09/15/22 12:30	5.1	0.002	1.2	1,087.2	2,578.2	233	0.007	2.5	1.8	12.8	101.5	139
09/15/22 12:31	5.4	0.002	1.3	1,087.2	2,588.5	234	0.007	2.5	1.9	12.8	101.9	139
09/15/22 12:32	5.3	0.002	1.3	1,087.2	2,578.5	233	0.008	2.9	2.1	12.8	101.5	139
09/15/22 12:33	4.7	0.002	1.1	1,087.2	2,571.1	232	0.006	2.4	1.8	12.8	101.2	139
09/15/22 12:34	4.9	0.002	1.2	1,087.2	2,586.4	233	0.007	2.5	1.8	12.8	101.8	139
09/15/22 12:35	5.3	0.002	1.3	1,087.2	2,574.3	232	0.007	2.5	1.8	12.8	101.3	139
09/15/22 12:36	5.3	0.002	1.2	1,087.1	2,581.4	233	0.006	2.3	1.7	12.8	101.6	139
09/15/22 12:37	5.9	0.002	1.4	1,087.1	2,580.6	233	0.006	2.4	1.7	12.8	101.6	139
09/15/22 12:38	5.4	0.002	1.3	1,087.1	2,571.3	232	0.007	2.5	1.8	12.8	101.2	139
09/15/22 12:39	5.2	0.002	1.2	1,087.1	2,574.7	232	0.007	2.6	1.9	12.8	101.4	139
09/15/22 12:40	5.5	0.002	1.3	1,087.1	2,582.0	233	0.007	2.5	1.8	12.8	101.7	139
09/15/22 12:41	5.7	0.002	1.4	1,087.1	2,570.6	232	0.007	2.5	1.8	12.8	101.2	139
09/15/22 12:42	5.3	0.002	1.3	1,087.1	2,578.3	233	0.006	2.4	1.8	12.8	101.5	139
09/15/22 12:43	5.3	0.002	1.3	1,087.1	2,569.8	232	0.006	2.4	1.8	12.8	101.2	139
09/15/22 12:44	4.9	0.002	1.2	1,087.1	2,574.5	232	0.006	2.4	1.8	12.8	101.4	139
09/15/22 12:45	5.0	0.002	1.2	1,087.1	2,580.0	232	0.008	2.9	2.1	12.8	101.6	139
09/15/22 12:46	4.7	0.002	1.1	1,087.1	2,573.0	232	0.006	2.3	1.7	12.8	101.3	139
09/15/22 12:47	5.0	0.002	1.2	1,087.1	2,573.2	232	0.006	2.3	1.7	12.8	101.3	139
09/15/22 12:48	4.8	0.002	1.1	1,087.1	2,566.9	231	0.006	2.3	1.6	12.8	101.0	139
09/15/22 12:49	5.0	0.002	1.2	1,087.1	2,575.8	233	0.007	2.7	1.9	12.8	101.4	139
Average	5.2	0.002	1.2	1,087.1	2,577.2	233	0.007	2.5	1.8	12.8	101.5	139

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covent Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/15/2022 09:13 Through 09/15/2022 14:27

Time Online Criteria: 1 minute(s)

Run 8

Source		UNIT03											
		CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
09/15/22	13:00	5.2	0.002	1.2	1,087.1	2,567.6	231	0.006	2.3	1.7	12.8	101.1	139
09/15/22	13:01	5.1	0.002	1.2	1,087.2	2,572.2	232	0.006	2.4	1.7	12.8	101.3	139
09/15/22	13:02	5.2	0.002	1.2	1,087.2	2,564.8	231	0.006	2.4	1.7	12.8	100.9	139
09/15/22	13:03	4.8	0.002	1.1	1,087.2	2,570.3	231	0.007	2.5	1.8	12.8	101.2	139
09/15/22	13:04	5.5	0.002	1.3	1,087.2	2,565.7	231	0.007	2.6	1.9	12.8	101.0	139
09/15/22	13:05	4.7	0.002	1.1	1,087.2	2,574.5	232	0.007	2.5	1.8	12.8	101.3	139
09/15/22	13:06	4.8	0.002	1.1	1,087.2	2,563.6	231	0.007	2.5	1.8	12.8	100.9	139
09/15/22	13:07	4.8	0.002	1.1	1,087.2	2,567.5	231	0.006	2.4	1.8	12.8	101.1	139
09/15/22	13:08	5.0	0.002	1.2	1,087.2	2,559.1	231	0.007	2.5	1.8	12.8	100.7	139
09/15/22	13:09	5.2	0.002	1.2	1,087.2	2,560.3	230	0.007	2.5	1.8	12.8	100.8	139
09/15/22	13:10	5.3	0.002	1.3	1,087.2	2,569.1	232	0.007	2.5	1.8	12.8	101.1	139
09/15/22	13:11	5.4	0.002	1.3	1,087.2	2,562.5	231	0.007	2.5	1.8	12.8	100.9	139
09/15/22	13:12	5.7	0.002	1.4	1,087.2	2,563.4	231	0.006	2.2	1.6	12.8	100.9	139
09/15/22	13:13	5.4	0.002	1.3	1,087.2	2,564.4	231	0.007	2.5	1.8	12.8	100.9	139
09/15/22	13:14	5.5	0.002	1.3	1,087.2	2,557.6	230	0.007	2.6	1.9	12.8	100.7	139
09/15/22	13:15	5.7	0.002	1.4	1,087.2	2,568.4	231	0.007	2.6	1.9	12.8	101.1	139
09/15/22	13:16	6.0	0.002	1.4	1,087.2	2,557.8	231	0.007	2.6	1.9	12.8	100.7	139
09/15/22	13:17	5.6	0.002	1.3	1,087.2	2,555.1	230	0.006	2.1	1.6	12.8	100.5	139
09/15/22	13:18	5.3	0.002	1.3	1,087.2	2,562.6	231	0.007	2.7	2.0	12.8	100.9	139
09/15/22	13:19	5.0	0.002	1.2	1,087.3	2,554.4	230	0.007	2.7	2.0	12.8	100.5	139
09/15/22	13:20	5.0	0.002	1.2	1,087.3	2,559.2	231	0.007	2.5	1.8	12.8	100.7	139
Average		5.2	0.002	1.2	1,087.1	2,563.8	231	0.007	2.5	1.8	12.8	100.9	139

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/15/2022 09:13 Through 09/15/2022 14:27

Time Online Criteria: 1 minute(s)

Source		UNIT03											
		Parameter Unit	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)
Run 9													
09/15/22	13:32	5.5	0.002	1.3	1,087.4	2,554.0	230	0.007	2.6	1.9	12.8	100.5	138
09/15/22	13:33	5.6	0.002	1.3	1,087.4	2,546.2	229	0.007	2.5	1.8	12.8	100.2	138
09/15/22	13:34	5.5	0.002	1.3	1,087.4	2,547.1	230	0.006	2.3	1.7	12.8	100.2	138
09/15/22	13:35	5.3	0.002	1.3	1,087.4	2,558.5	230	0.007	2.7	2.0	12.8	100.7	138
09/15/22	13:36	4.7	0.002	1.1	1,087.4	2,546.1	229	0.007	2.4	1.8	12.9	100.2	138
09/15/22	13:37	5.1	0.002	1.2	1,087.5	2,561.9	231	0.006	2.4	1.8	12.8	100.8	138
09/15/22	13:38	5.0	0.002	1.2	1,087.5	2,548.8	229	0.007	2.5	1.8	12.8	100.3	138
09/15/22	13:39	4.7	0.002	1.1	1,087.5	2,553.8	230	0.006	2.2	1.6	12.8	100.5	138
09/15/22	13:40	4.8	0.002	1.2	1,087.5	2,545.6	229	0.008	2.8	2.0	12.8	100.1	138
09/15/22	13:41	4.8	0.002	1.1	1,087.5	2,553.4	229	0.006	2.4	1.8	12.8	100.5	138
09/15/22	13:42	5.1	0.002	1.2	1,087.5	2,551.5	230	0.007	2.6	1.9	12.8	100.4	138
09/15/22	13:43	5.0	0.002	1.2	1,087.6	2,551.6	229	0.006	2.1	1.5	12.8	100.4	138
09/15/22	13:44	5.5	0.002	1.3	1,087.6	2,556.4	230	0.007	2.5	1.8	12.8	100.6	138
09/15/22	13:45	5.1	0.002	1.2	1,087.6	2,545.2	229	0.007	2.6	1.9	12.8	100.1	138
09/15/22	13:46	5.6	0.002	1.3	1,087.6	2,553.8	229	0.007	2.5	1.8	12.8	100.5	138
09/15/22	13:47	5.2	0.002	1.2	1,087.6	2,554.8	229	0.007	2.5	1.9	12.8	100.5	138
09/15/22	13:48	5.4	0.002	1.3	1,087.6	2,555.0	229	0.007	2.5	1.8	12.8	100.5	138
09/15/22	13:49	5.6	0.002	1.3	1,087.6	2,557.2	229	0.007	2.5	1.8	12.8	100.6	138
09/15/22	13:50	5.4	0.002	1.3	1,087.6	2,544.9	228	0.006	2.4	1.7	12.8	100.1	138
09/15/22	13:51	5.5	0.002	1.3	1,087.6	2,554.8	230	0.007	2.5	1.8	12.8	100.5	138
09/15/22	13:52	5.1	0.002	1.2	1,087.6	2,550.6	229	0.007	2.6	1.9	12.8	100.3	138
Average		5.2	0.002	1.2	1,087.5	2,552.0	229	0.007	2.5	1.8	12.8	100.4	138

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect

U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

RATA 1-Minute Data Report

Plant: New Covert Eastern Generation

Interval: 1 Minute

Type: Roll

Report Period: 09/15/2022 09:13 Through 09/15/2022 14:27

Time Online Criteria: 1 minute(s)

Source		UNIT03											
Parameter	Unit	CO#/HR (LB/HR)	CO#/MM (LB/MMBTU)	COPPM (PPM)	GASGCV (BTU/SCF)	HEATIN (MMBTU/HR)	LOADMW (MW)	NOX#/MM (LB/MMBTU)	NOXPPM (PPM)	NOXPPMC (PPMC)	O2 (PERCENT)	RGASFLW (HPPH)	STMLOAD (MW)
Run													
10													
09/15/22	14:07	5.3	0.002	1.3	1,087.7	2,552.6	230	0.007	2.6	1.9	12.8	100.4	138
09/15/22	14:08	5.5	0.002	1.3	1,087.7	2,547.7	228	0.006	2.3	1.7	12.8	100.2	138
09/15/22	14:09	5.1	0.002	1.2	1,087.7	2,544.8	228	0.006	2.4	1.7	12.8	100.1	138
09/15/22	14:10	4.5	0.002	1.1	1,087.7	2,548.8	229	0.007	2.6	1.9	12.8	100.3	138
09/15/22	14:11	4.6	0.002	1.1	1,087.7	2,544.9	228	0.007	2.7	2.0	12.8	100.1	138
09/15/22	14:12	4.6	0.002	1.1	1,087.7	2,551.2	229	0.007	2.6	1.9	12.8	100.3	138
09/15/22	14:13	4.7	0.002	1.1	1,087.7	2,547.4	229	0.007	2.5	1.8	12.8	100.2	138
09/15/22	14:14	4.6	0.002	1.1	1,087.7	2,546.1	228	0.006	2.4	1.8	12.8	100.2	138
09/15/22	14:15	4.9	0.002	1.2	1,087.7	2,545.8	229	0.006	2.3	1.7	12.8	100.1	138
09/15/22	14:16	5.2	0.002	1.3	1,087.7	2,544.1	229	0.006	2.4	1.7	12.8	100.1	138
09/15/22	14:17	5.0	0.002	1.2	1,087.7	2,556.0	230	0.007	2.5	1.8	12.8	100.6	138
09/15/22	14:18	5.3	0.002	1.3	1,087.8	2,540.0	228	0.007	2.5	1.9	12.8	99.9	138
09/15/22	14:19	5.4	0.002	1.3	1,087.8	2,552.3	229	0.007	2.5	1.8	12.8	100.4	138
09/15/22	14:20	5.8	0.002	1.4	1,087.8	2,551.7	230	0.006	2.4	1.8	12.8	100.4	138
09/15/22	14:21	5.4	0.002	1.3	1,087.8	2,542.4	228	0.006	2.4	1.8	12.8	100.0	138
09/15/22	14:22	5.8	0.002	1.4	1,087.8	2,548.9	229	0.007	2.5	1.8	12.8	100.2	138
09/15/22	14:23	5.4	0.002	1.3	1,087.8	2,549.0	229	0.008	3.1	2.2	12.8	100.2	138
09/15/22	14:24	5.6	0.002	1.4	1,087.8	2,549.2	229	0.006	2.3	1.7	12.8	100.3	138
09/15/22	14:25	5.4	0.002	1.3	1,087.8	2,549.5	229	0.006	2.3	1.7	12.8	100.3	138
09/15/22	14:26	5.3	0.002	1.3	1,087.8	2,551.7	229	0.006	2.2	1.6	12.8	100.4	138
09/15/22	14:27	5.2	0.002	1.2	1,087.8	2,553.0	229	0.006	2.3	1.7	12.8	100.4	138
Average		5.2	0.002	1.2	1087.7	2548.4	229	0.007	2.5	1.8	12.8	100.2	138

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

M = Maintenance

T = Out Of Control

* = Suspect


U = Startup

Version 6.18

R Project No. M223705D
Units 001, 002, and 003

Appendix B - Test Section Diagram

GASEOUS TRAVERSE FOR ROUND DUCTS

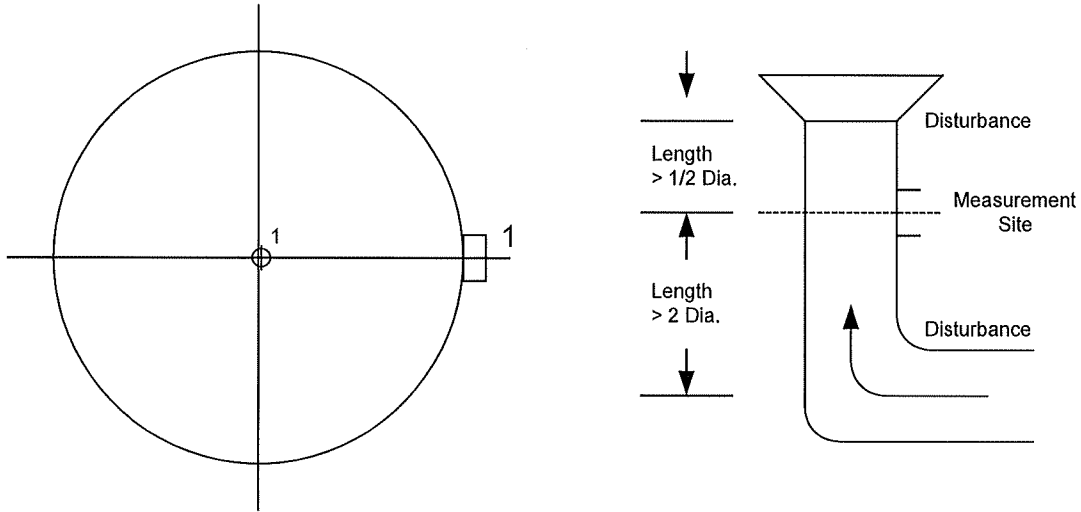

Job: New Covert Generating Company, LLC
New Covert Generating Facility
Covert, Michigan

Date: September 13, 2022

Test Location: Unit 001 Stack

Stack Diameter: 22.1 Feet

Stack Area: 383.60 Square Feet


Upstream Disturbance: 0.820

Downstream Disturbance: 3.440

No. Sample Points: 1

Port Length: 12.25 Inches

GASEOUS TRAVERSE FOR ROUND DUCTS

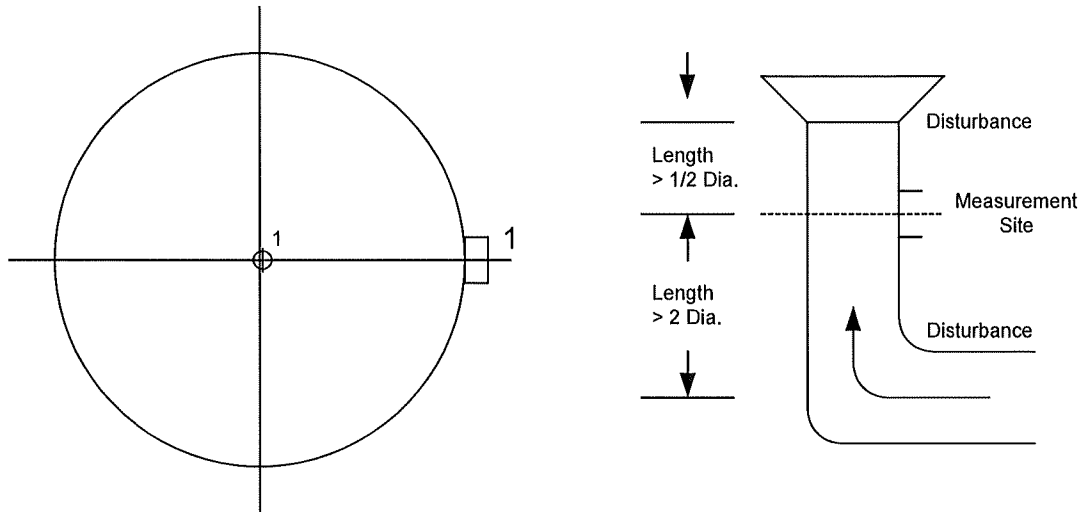

Job: New Covert Generating Company, LLC
New Covert Generating Facility
Covert, Michigan

Date: September 14, 2022

Test Location: Unit 002 Stack

Stack Diameter: 22.083 Feet

Stack Area: 383.02 Square Feet


Upstream Disturbance: 240 Inches (0.91 diameters)

Downstream Disturbance: 1,020 Inches (3.85 diameters)

No. Sample Points: 1

Port Length: 12 Inches

GASEOUS TRAVERSE FOR ROUND DUCTS

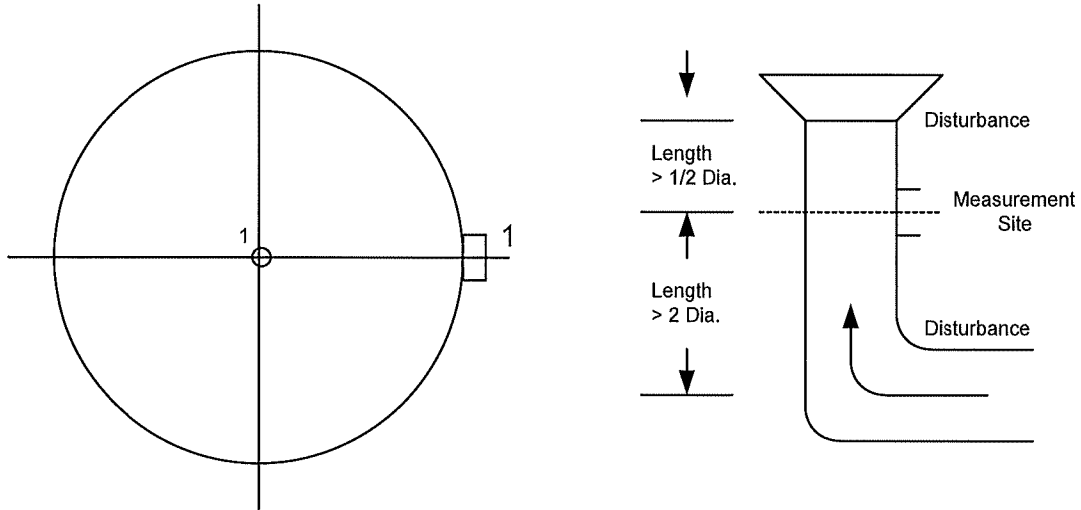

Job: New Covert Generating Company, LLC
New Covert Generating Facility
Covert, Michigan

Date: September 15, 2022

Test Location: Unit 003 Stack

Stack Diameter: 22.1 Feet

Stack Area: 383.60 Square Feet

Upstream Disturbance: 0.820


Downstream Disturbance: 3.440

No. Sample Points: 1

Port Length: 12.25 Inches

Appendix C - Sample Train Diagram

USEPA Methods 3A, 25A, and 320 – Sample Train Diagram

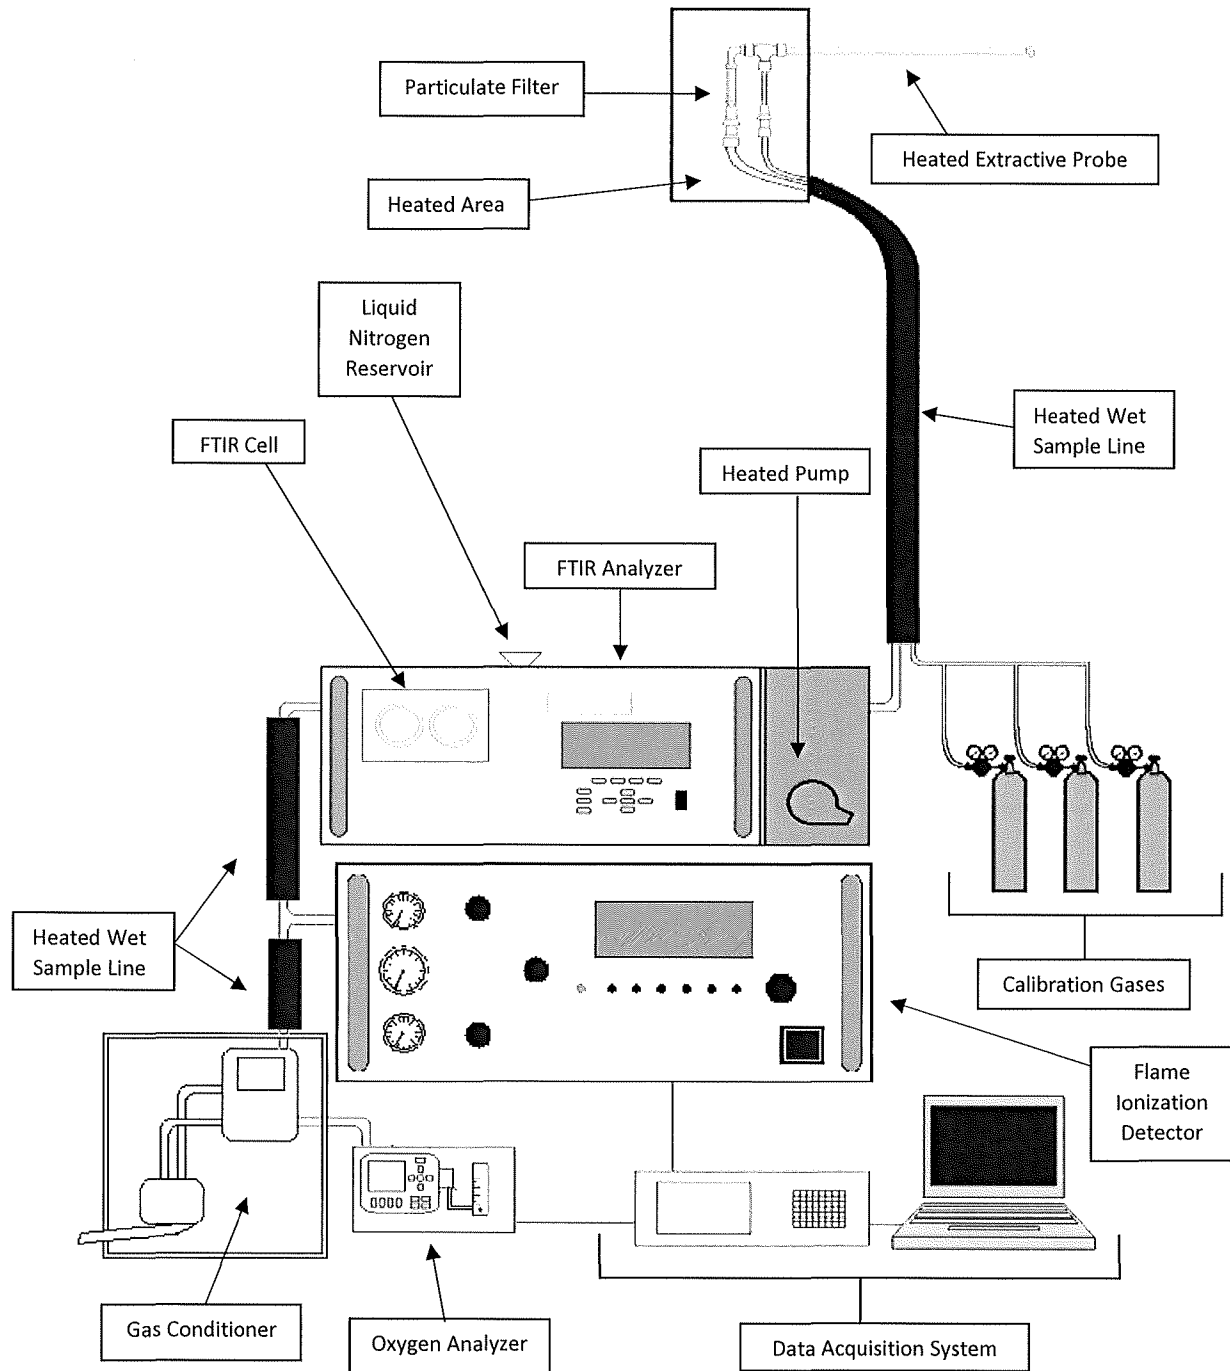

Appendix D - Calculation Nomenclature and Formulas

Client: New Covert Generating Company, LLC
Facility: New Covert Generating Facility
Project #: M223705
Test Location: Unit 001
Date: 9/13/22

Sample Calculations

$$(12.68\% - 0.07\%) \times \frac{\text{O2 \% (dry)} \quad 9.07\%}{9.12\% - 0.07\%} = 12.63\%$$

$$C_{\text{gas}} = (C - C_o) \times \frac{C_{\text{ma}}}{C_m - C_o}$$

where:

C_{gas} = Effluent gas concentration, dry basis, ppm or %

C = Average gas concentration indicated by gas analyzer, dry basis, ppm or %

C_o = Average of initial and final system calibration bias check responses for the zero gas, ppm or %

C_m = Average of initial and final system calibration bias check responses for the upscale calibration gas, ppm or %

C_{ma} = Actual concentration of the upscale calibration gas, ppm or %

MOSTARDI PLATT

Pollutant Concentration Correction 15% for Percent Oxygen

$$C_{adj} = C_d \frac{20.9 - 15\%}{20.9 - \%O_2}$$

where:

C_{adj} = Pollutant concentration corrected to percent O_2

20.9-15% = Percent O_2 , the defined O_2 correction value, percent

20.9 = Percent O_2 in air

$\%O_2$ = Measured O_2 concentration dry basis, percent

C_d = Pollutant concentration measured, dry basis, ppm.

Appendix E - Reference Method Test Data