

RECEIVED**OCT 01 2018****Executive Summary****OLYMPIA ENTERTAINMENT
DETROIT EVENTS CENTER
CUMMINS MODEL GTA28 SI-RICE GENSETS
EMISSION TEST RESULTS****AIR QUALITY DIVISION**

Olympia Entertainment contracted Derenzo Environmental Services (DES) to conduct a performance demonstration for the determination of nitrogen oxides (NO_x), carbon monoxide (CO), and volatile organic compounds (VOC) concentrations from two (2) Cummins Model GTA28 natural gas-fired reciprocating internal combustion engines (RICE) and electricity generator sets operated at the Detroit Events Center in Detroit, Wayne County.

The RICE generator sets are required to be tested every 8,760 hours of operation (or at least every three years) in accordance with the provisions of 40 CFR Part 60 Subpart JJJJ (NSPS for spark ignition internal combustion engines). This was the initial test event for these units.

The following table presents the emissions results from the performance demonstration.

Emission Unit	NO _x Concentration (ppmvd @ 15% O ₂)	CO Concentration (ppmvd @ 15% O ₂)	VOC Concentration (ppmvd @ 15% O ₂)
Tower A Engine	64.4	158	2.65
Tower C Engine	92.1	109	2.09
Permit Limits	160	540	86

Parts per million by volume, dry basis, corrected to 15% oxygen. VOC concentration is C₃ (propane).

A Cummins Model GTA28 has a maximum electricity generation rate of 450 kilowatts. The Detroit Events Center RICE generator sets operated between 430-433 kW during the performance demonstration.

The data presented above indicate that the GTA28 engines were tested while the units operated within 10% of maximum capacity (701 HP and 450 kW) and are in compliance with the emission standards specified in 40 CFR 60.4243(e).

NSPS EMISSION TEST REPORT

Title NSPS EMISSION TEST REPORT FOR THE VERIFICATION
OF AIR POLLUTANT EMISSIONS FROM NATURAL GAS
FIRED INTERNAL COMBUSTION ENGINE EMERGENCY
GENERATOR SETS

Report Date September 25, 2018

Test Date(s) September 12-13, 2018

Facility Information

Name	Olympia Entertainment - Detroit Events Center
Street Address	2645 Woodward Avenue
City, County	Detroit, Wayne
SRN	None

Emission Unit Information

Location:	Detroit Events Center
Emission Unit:	Cummins GTA28, 450 kW SI-RICE Gensets

Testing Contractor

Company	Derenzo Environmental Services
Mailing Address	39395 Schoolcraft Road Livonia, MI 48150
Phone	(734) 464-3880
Project No.	1808006

TABLE OF CONTENTS

	Page
1.0 INTRODUCTION	1
2.0 SOURCE AND SAMPLING LOCATION DESCRIPTION	3
2.1 General Process Description	3
2.2 Rated Capacities and Air Emission Controls.....	3
2.3 Sampling Locations.....	3
3.0 SUMMARY OF TEST RESULTS AND OPERATING CONDITIONS	4
3.1 Purpose and Objective of the Tests.....	4
3.2 Operating Conditions During the Compliance Tests	4
3.3 Summary of Air Pollutant Sampling Results.....	4
4.0 SAMPLING AND ANALYTICAL PROCEDURES	5
4.1 Summary of Sampling Methods.....	5
4.2 Exhaust Gas Molecular Weight Determination (USEPA Methods 3A).....	5
4.3 Exhaust Gas Moisture Content (USEPA Method 4)	6
4.4 NO _x and CO Concentration Measurements (USEPA Methods 7E and 10).....	6
4.5 Measurement of VOCs (USEPA Method ALT-096).....	6
5.0 QA/QC ACTIVITIES.....	7
5.1 NO _x Converter Efficiency Test	7
5.2 Sampling System Response Time Determination.....	7
5.3 Gas Divider Certification (USEPA Method 205)	8
5.4 Instrumental Analyzer Interference Check	8
5.5 Instrument Calibration and System Bias Checks	8
5.6 Meter Box Calibrations	9
5.7 Determination of Exhaust Gas Stratification.....	9
6.0 RESULTS	9
6.1 Test Results and Allowable Emission Limits	9
6.2 Variations from Normal Sampling Procedures or Operating Conditions.....	10

LIST OF TABLES

Table	Page
3.1 Average measured air pollutant concentrations for the Detroit Events Center SI-RICE gensets (three-test average)	5
6.1 Measured exhaust gas conditions and NO _x , CO, and VOC air pollutant concentrations for the Detroit Events Center SI-RICE Tower C genset	11
6.2 Measured exhaust gas conditions and NO _x , CO, and VOC air pollutant concentrations for the Detroit Events Center SI-RICE Tower A genset	12

LIST OF APPENDICES

APPENDIX A	SAMPLING DIAGRAMS
APPENDIX B	OPERATING RECORDS
APPENDIX C	MOISTURE CALCULATIONS AND FIELD DATA SHEETS
APPENDIX D	CO ₂ , O ₂ , CO, NO _x , AND VOC CALCULATIONS
APPENDIX E	INSTRUMENTAL ANALYZER RAW DATA
APPENDIX F	QA/QC RECORDS

NSPS EMISSION TEST REPORT
FOR THE
VERIFICATION OF AIR POLLUTANT EMISSIONS
FROM
NATURAL GAS FUELED INTERNAL COMBUSTION ENGINE
EMERGENCY GENERATOR SETS

OLYPIA ENTERTAINMENT
DETROIT EVENTS CENTER

RECEIVED

OCT 01 2018

1.0 INTRODUCTION

AIR QUALITY DIVISION

Olympia Entertainment operates two (2) natural gas fired, spark-ignition reciprocating internal combustion engine emergency generator sets (SI-RICE genset) located at the Detroit Events Center in Detroit, Wayne County.

Each SI-RICE emergency generator set is a Cummins Model GTA28 that has a rated electricity output of 450 kW at the rated engine power output of 701 horsepower (hp). The units are subject to the SI-RICE New Source Performance Standard (NSPS) codified in 40 CFR Part 60 Subpart JJJJ. The SI-RICE NSPS specifies that:

- 1. Owners and operators of stationary SI ICE with a maximum engine power greater than or equal to 75 kW (except gasoline and rich burn engines that use LPG) must comply with the emission standards in Table 1 to this subpart for their stationary SI ICE.*
- 2. If you are an owner or operator of a stationary SI internal combustion engine greater than 500 HP...you must conduct an initial performance test within 1 year of engine startup and conduct subsequent performance testing every 8,760 hours or 3 years, whichever comes first, thereafter to demonstrate compliance.*

The compliance testing was performed by Derenzo Environmental Services (DES), a Michigan-based environmental consulting and testing company. DES representatives Tyler Wilson, Tom Andrews, and Kevin Anderson performed the field sampling and measurements September 12-13, 2018.

The exhaust gas sampling and analysis was performed using procedures specified in the Test Plan that was reviewed and approved by the MDEQ-AQD in the August 28, 2018 test plan approval letter. MDEQ-AQD representatives Mr. Mark Dziadosz and Ms. Gina Hines observed portions of the testing project.

Derenzo Environmental Services

Olympia Entertainment - Detroit Events Center
NSPS Emission Test Report

September 25, 2018
Page 2

Questions regarding this emission test report should be directed to:

Tyler J. Wilson
Livonia Office Supervisor
Derenzo Environmental Services
39395 Schoolcraft Road
Livonia, MI 48150
Ph: (734) 464-3880
twilson@derenzo.com

Mr. Stephen Hennard
Facility Manager
Fox Office Center
2211 Woodward Ave
Detroit, MI 48201-3467
Ph: (313) 471-3424
stephan.hennard@olydev.com

Report Certification

This test report was prepared by Derenzo Environmental Services based on field sampling data collected by Derenzo Environmental Services. Facility process data were collected and provided by Cummins employees or representatives. This test report has been reviewed by Olympia Entertainment representatives and approved for submittal to the Michigan Department of Environmental Quality.


I certify that the testing was conducted in accordance with the approved test plan unless otherwise specified in this report. I believe the information provided in this report and its attachments are true, accurate, and complete.

Report Prepared By:



Brad Thome
Environmental Consultant
Derenzo Environmental Services

Reviewed By:

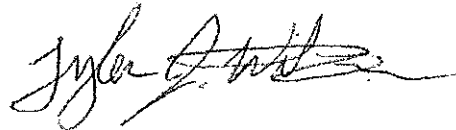

Tyler J. Wilson
Livonia Office Supervisor
Derenzo Environmental Services

2.0 SOURCE AND SAMPLING LOCATION DESCRIPTION

2.1 General Process Description

The SI-RICE gensets are classified as emergency generators and are only operated to provide emergency power to the facility during power outages and for periodic maintenance testing.

2.2 Rated Capacities and Air Emission Controls

Each Cummins Model GTA28 SI-RICE genset has a rated output of 701 horsepower (HP) and the connected generator has a rated electricity output of 450 kilowatts (kW). The engines are fueled exclusively with pipeline natural gas and equipped with an air-to-fuel ratio controller.

Each engine is equipped with a non-selective catalytic reduction (NSCR) system for passively controlling CO, NO_x, and hydrocarbon (HC) emissions. The NSCR system consists of two catalyst beds that allow CO and HC to be oxidized by the oxygen that is a component of the NO_x. This system relies on a low concentration of oxygen at the catalyst bed inlet. Each engine is equipped with controls to adjust the fuel-air-ratio of the engine intake manifold.

The NSCR is passive in nature and its efficiency is dependent on exhaust gas temperature and oxygen content as well as catalyst bed condition. In accordance with 40 CFR 60.4243, the air-to-fuel ration controller is optimized for emissions reduction.

2.3 Sampling Locations

Each RICE exhaust gas is released to the atmosphere through two (2) identical vertical exhaust stacks with vertical release points.

Prior to the test event, vertical exhaust stack extensions were installed by DES personnel to provide sampling locations that meet USEPA Method 1 criteria. Each stack extension had an inner diameter of 8 inches and was equipped with two (2) sample ports, opposed 90°, that provide a sampling location 14.3 inches (1.8 duct diameters) upstream and 44.0 inches (5.5 duct diameters) downstream from any flow disturbance. The stack extensions were removed following compliance testing.

Appendix A provides diagrams of the emission test sampling locations.

3.0 SUMMARY OF TEST RESULTS AND OPERATING CONDITIONS

3.1 Purpose and Objective of the Tests

The provisions of 40 CFR Part 60 Subpart JJJJ require Olympia Entertainment to test each SI-RICE for carbon monoxide (CO), nitrogen oxides (NO_x), and volatile organic compounds (VOC) emissions every 8,760 hours of operation or 3 years, whichever comes first. Measurements were performed for the RICE exhaust to determine CO, NO_x, and VOC (as non-methane hydrocarbons, NMHC) concentrations and diluent gas content (oxygen and carbon dioxide). This was the initial test event for these units.

3.2 Operating Conditions During the Compliance Tests

The testing was performed while the SI-RICE gensets were operated within at least 10% of maximum rated capacity of 450 kW electricity output. Cummins representatives (hired by Olympia Entertainment) provided kW output data at 15-minute intervals for each test period. The Detroit Events Center RICE generator sets operated between 430-433 kW during the test periods (96% of maximum capacity).

Appendix B provides operating records provided by Cummins representatives for the test periods.

3.3 Summary of Air Pollutant Sampling Results

The gases exhausted from each SI-RICE genset were sampled for three (3) one-hour test periods during the compliance testing performed September 12-13, 2018.

Table 3.1 presents the average measured CO, NO_x, and VOC emission rates for the engines (average of the three test periods for each engine) and applicable emission limits.

Results of the engine performance tests demonstrate compliance with emission limits specified in 40 CFR Part 60 Subpart JJJJ. Test results for each one-hour sampling period are presented in Section 6.0 of this report.

Table 3.1 Average measured emission concentrations for the RICE gensets (three-test average)

Emission Unit	CO Concentration (ppmvd) [†]	NOx Concentration (ppmvd) [†]	VOC Concentration (ppmvd) [†]
Engine A	158	64.4	2.65
Engine C	109	92.1	2.09
Emission Standard	540	160	86

[†] Parts per million by volume, dry basis, corrected to 15% oxygen. VOC concentration is C₃ (propane).

4.0 SAMPLING AND ANALYTICAL PROCEDURES

A protocol for the air emission testing was reviewed and approved by the MDEQ-AQD. This section provides a summary of the sampling and analytical procedures that were used during the testing periods.

4.1 Summary of Sampling Methods

USEPA Method 3A	Exhaust gas O ₂ and CO ₂ content was determined using paramagnetic and infrared instrumental analyzers, respectively.
USEPA Method 4	Exhaust gas moisture was determined based on the water weight gain in chilled impingers.
USEPA Method 7E	Exhaust gas NOx concentration was determined using a chemiluminescence instrumental analyzer.
USEPA Method 10	Exhaust gas CO concentration was measured using an NDIR instrumental analyzer.
USEPA Method 25A /ALT-096	Exhaust gas VOC (as NMHC) concentration was determined using a flame ionization analyzer equipped with an internal methane separation GC column.

4.2 Exhaust Gas Molecular Weight Determination (USEPA Method 3A)

CO₂ and O₂ content in the RICE exhaust gas stream was measured continuously throughout each test period in accordance with USEPA Method 3A. The exhaust gas CO₂ content was monitored using a Servomex 1440D single beam single wavelength (SBSW) infrared gas analyzer. The exhaust gas O₂ content was monitored using a paramagnetic sensor within the Servomex 1440D gas analyzer.

During each sampling period, a continuous sample of the RICE exhaust gas stream was extracted from the stack using a stainless steel probe connected to a Teflon® heated sample line. The

sampled gas was conditioned by removing moisture prior to being introduced to the analyzers; therefore, measurement of O₂ and CO₂ concentrations correspond to standard dry gas conditions. Instrument response data were recorded using an ESC Model 8816 data acquisition system that monitored the analog output of the instrumental analyzers continuously and logged data as one-minute averages.

Prior to, and at the conclusion of each test, the instruments were calibrated using upscale calibration and zero gas to determine analyzer calibration error and system bias (described in Section 5.0 of this document). Sampling times were recorded on field data sheets.

Appendix C provides handwritten field data sheets and exhaust gas moisture calculations.

Appendix D provides O₂ and CO₂ calculation sheets. Raw instrument response data are provided in Appendix E.

4.3 Exhaust Gas Moisture Content (USEPA Method 4)

Moisture content of the RICE exhaust gas was determined in accordance with USEPA Method 4 using a chilled impinger sampling train. The moisture sampling was performed concurrently with the instrumental analyzer sampling. During each sampling period, a gas sample was extracted at a constant rate from the source where moisture was removed from the sampled gas stream using impingers that were submersed in an ice bath. At the conclusion of each sampling period, the moisture gain in the impingers was determined gravimetrically by weighing each impinger to determine net weight gain.

4.4 NO_x and CO Concentration Measurements (USEPA Methods 7E and 10)

NO_x and CO pollutant concentrations in the RICE exhaust gas streams were determined using a Thermo Environmental Instruments, Inc. (TEI) Model 42c High Level chemiluminescence NO_x analyzer and a TEI Model 48i infrared CO analyzer.

Throughout each test period, a continuous sample of the engine exhaust gas was extracted from the stack using the heated sample line and gas conditioning system described previously in this section. Prior to, and at the conclusion of each test, the instruments were calibrated using upscale calibration and zero gas to determine analyzer calibration error and system bias.

Appendix D provides CO and NO_x calculation sheets. Raw instrument response data are provided in Appendix E.

4.5 Measurement of Volatile Organic Compounds (USEPA Methods 25A and ALT-096)

The VOC emission rate was determined by measuring the nonmethane hydrocarbon (NMHC) concentration in the engine exhaust gas. NMHC pollutant concentration was determined using a TEI Model 55i Methane / Nonmethane hydrocarbon analyzer. The TEI 55i analyzer contains an internal gas chromatograph column that separates methane from non-methane components. The

concentration of NMHC in the sampled gas stream, after separation from methane, is determined relative to a propane standard using a flame ionization detector in accordance with USEPA Method 25A.

The USEPA Office of Air Quality Planning and Standards (OAQPS) has issued several alternate test methods approving the use of the TEI 55-series analyzer as an effective instrument for measuring NMOC from gas-fueled reciprocating internal combustion engines (RICE) in that it uses USEPA Method 25A and 18 (ALT-066, ALT-078 and ALT-096).

Samples of the exhaust gas were delivered directly to the instrumental analyzer using the Teflon® heated sample line to prevent condensation. The sample to the NMHC analyzer was not conditioned to remove moisture. Therefore, VOC measurements correspond to standard conditions with no moisture correction (wet basis).

Prior to, and at the conclusion of each test, the instrument was calibrated using mid-range calibration (propane) and zero gas to determine analyzer calibration error and system bias.

Appendix D provides VOC calculation sheets. Raw instrument response data for the NMHC analyzer is provided in Appendix E.

5.0 QA/QC ACTIVITIES

5.1 NO_x Converter Efficiency Test

The NO₂ – NO conversion efficiency of the Model 42c analyzer was verified prior to the testing program. A USEPA Protocol 1 certified concentration of NO₂ was injected directly into the analyzer, following the initial three-point calibration, to verify the analyzer's conversion efficiency. The analyzer's NO₂ – NO converter uses a catalyst at high temperatures to convert the NO₂ to NO for measurement. The conversion efficiency of the analyzer is deemed acceptable if the measured NO₂ concentration is greater than or equal to 90% of the expected value.

The NO₂ – NO conversion efficiency test satisfied the USEPA Method 7E criteria (measured NO₂ concentration was 97.1% of the expected value, i.e., greater than 90% of the expected value as required by Method 7E).

5.2 Sampling System Response Time Determination

The response time of the sampling system was determined prior to the compliance test program by introducing upscale gas and zero gas, in series, into the sampling system using a tee connection at the base of the sample probe. The elapsed time for the analyzer to display a reading of 95% of the expected concentration was determined using a stopwatch.

The TEI Model 42c analyzer exhibited the longest system response time at 69 seconds. Results of the response time determinations were recorded on field data sheets. For each test period, test

data were collected once the sample probe was in position for at least twice the maximum system response time.

5.3 Gas Divider Certification (USEPA Method 205)

A STEC Model SGD-710C 10-step gas divider was used to obtain appropriate calibration span gases. The ten-step STEC gas divider was NIST certified (within the last 12 months) with a primary flow standard in accordance with Method 205. When cut with an appropriate zero gas, the ten-step STEC gas divider delivered calibration gas values ranging from 0% to 100% (in 10% step increments) of the USEPA Protocol 1 calibration gas that was introduced into the system. The field evaluation procedures presented in Section 3.2 of Method 205 were followed prior to use of gas divider. The field evaluation yielded no errors greater than 2% of the triplicate measured average and no errors greater than 2% from the expected values.

5.4 Instrumental Analyzer Interference Check

The instrumental analyzers used to measure NO_x, CO, O₂, and CO₂ have had an interference response test performed prior to their use in the field pursuant to the interference response test procedures specified in USEPA Method 7E. The appropriate interference test gases (i.e., gases that would be encountered in the exhaust gas stream) were introduced into each analyzer, separately and as a mixture with the analyte that each analyzer is designed to measure. All of analyzers exhibited a composite deviation of less than 2.5% of the span for all measured interferent gases. No major analytical components of the analyzers have been replaced since performing the original interference tests.

5.5 Instrument Calibration and System Bias Checks

At the beginning the day of the testing program, initial three-point instrument calibrations were performed for the NO_x, CO, CO₂, and O₂ analyzers by injecting calibration gas directly into the inlet sample port for each instrument. System bias checks were performed prior to and at the conclusion of each sampling period by introducing the upscale calibration gas and zero gas into the sampling system (at the base of the stainless steel sampling probe prior to the particulate filter and Teflon® heated sample line) and determining the instrument response against the initial instrument calibration readings.

At the beginning of the test day, appropriate high-range, mid-range, and low-range span gases followed by a zero gas were introduced to the NMHC analyzer, in series at a tee connection, which is installed between the sample probe and the particulate filter, through a poppet check valve. After each one hour test period, mid-range and zero gases were re-introduced in series at the tee connection in the sampling system to check against the method's performance specifications for calibration drift and zero drift error.

The instruments were calibrated with USEPA Protocol 1 certified concentrations of CO₂, O₂, NO_x, and CO in nitrogen and zeroed using hydrocarbon free nitrogen. The NMHC (VOC) instrument was calibrated with USEPA Protocol 1 certified concentrations of propane in air and

zeroed using hydrocarbon-free air. A STEC Model SGD-710C ten-step gas divider was used to obtain intermediate calibration gas concentrations as needed.

5.6 Meter Box Calibrations

RECEIVED

The Nutech Model 2010 dry gas meter and sampling console, which was used for exhaust gas moisture content sampling, was calibrated prior to and after the testing program. This calibration uses the critical orifice calibration technique presented in USEPA Method 5. The console calibration exhibited no data outside the acceptable ranges presented in USEPA Method 5.

The digital pyrometer in the Nutech metering consoles were calibrated using a NIST traceable Omega® Model CL 23A temperature calibrator.

5.7 Determination of Exhaust Gas Stratification

A stratification test was performed for each RICE exhaust stack. The stainless steel sample probe was positioned at sample points correlating to 16.7, 50.0 (centroid) and 83.3% of the stack diameter. Pollutant concentration data were recorded at each sample point for a minimum of twice the maximum system response time.

The recorded concentration data for each RICE exhaust stack indicate that the measured O₂ and CO₂ concentrations did not vary by more than 5% of the mean across the stack diameter. Therefore, the RICE exhaust gas was considered to be unstratified and the compliance test sampling was performed at a single sampling location within the RICE exhaust stack.

Appendix F presents test equipment quality assurance data (NO₂ – NO conversion efficiency test data, instrument calibration and system bias check records, calibration gas and gas divider certifications, interference test results, and meter box calibration records).

6.0 RESULTS

6.1 Test Results and Allowable Emission Limits

Engine operating data and air pollutant emission measurement results for each one-hour test period are presented in Tables 6.1 and 6.2. The serial number (SN) for each RICE is presented at the top of each table.

The measured average air pollutant concentrations for each SI-RICE are less than the allowable limits specified in 40 CFR Part 60 Subpart JJJJ for the engines:

- 540 parts per million by volume, dry basis, corrected to 15% oxygen (ppmvd @ 15% O₂) CO;
- 160 ppmvd @ 15% O₂ NO_x; and
- 86 ppmvd @ 15% O₂ VOC.

6.2 Variations from Normal Sampling Procedures or Operating Conditions

The testing for all pollutants was performed in accordance with the approved test protocol. The engine-generator set was operated within 10% of maximum output.

The original testing schedule was adjusted from September 11-12, 2018 to September 12-13, 2018 due to operational issues with the Tower C Engine on September 11, 2018. Cummins representatives were able to repair operational issues with the Tower C Engine the evening of September 11, 2018 and testing was performed on the Tower C Engine on September 12, 2018 and the Tower A engine on September 13, 2018. The testing schedule adjustment was discussed with, and approved by MDEQ-AQD representative Mark Dziadosz.

Derenzo Environmental Services

Olympia Entertainment - Detroit Events Center
NSPS Emission Test Report

September 25, 2018
Page 11

Table 6.1 Measured exhaust gas conditions and NO_x, CO, and VOC air pollutant concentrations for Detroit Events Center SI-RICE genset Tower C, SN: 25420170

Test No.	1	2	3	
Test date	9/12/18	9/12/18	9/12/18	Three Test
Test period (24-hr clock)	955 - 1105	1135 - 1242	1320 - 1440	Average
Generator output (kW)	431	431	433	432
<u>Exhaust Gas Composition</u>				
CO ₂ content (% vol)	12.0	11.7	11.9	11.9
O ₂ content (% vol)	0.45	0.92	0.66	0.68
Moisture (% vol)	10.7	10.5	10.1	10.4
<u>Nitrogen Oxides</u>				
NO _x conc. (ppmvd)	280	376	290	315
NO _x conc. corrected to 15% O ₂	80.7	111	84.4	92.1
NO _x permit limit @ 15% O ₂ (ppmvd)	-	-	-	160
<u>Carbon Monoxide</u>				
CO conc. (ppmvd)	449	180	493	374
CO conc. corrected to 15% O ₂	129	53.3	144	109
CO permit limit @ 15% O ₂ (ppmvd)	-	-	-	540
<u>Volatile Organic Compounds</u>				
VOC conc. (ppmv C ₃)	6.55	5.14	5.68	5.79
VOC conc. corrected to 15% O ₂ (dry)	2.34	1.88	2.04	2.09
VOC permit limit @ 15% O ₂ (ppmvd)	-	-	-	86

Derenzo Environmental Services

Olympia Entertainment - Detroit Events Center
NSPS Emission Test Report

September 25, 2018
Page 12

Table 6.2 Measured exhaust gas conditions and NO_x, CO, and VOC air pollutant concentrations for Detroit Events Center SI-RICE genset Tower A, SN: 25420168


Test No.	1	2	3	
Test date	9/13/18	9/13/18	9/13/18	Three Test
Test period (24-hr clock)	845 - 950	1015 - 1120	1147 - 1252	Average
Generator output (kW)	430	431	431	431
<u>Exhaust Gas Composition</u>				
CO ₂ content (% vol)	10.9	11.1	11.6	11.2
O ₂ content (% vol)	1.37	1.46	0.62	1.15
Moisture (% vol)	10.9	10.7	10.8	10.8
<u>Nitrogen Oxides</u>				
NO _x conc. (ppmvd)	226	199	222	216
NO _x conc. corrected to 15% O ₂	68.3	60.3	64.7	64.4
NO _x permit limit @ 15% O ₂ (ppmvd)	-	-	-	160
<u>Carbon Monoxide</u>				
CO conc. (ppmvd)	522	503	565	530
CO conc. corrected to 15% O ₂	158	153	165	158
CO permit limit @ 15% O ₂ (ppmvd)	-	-	-	540
<u>Volatile Organic Compounds</u>				
VOC conc. (ppmv C ₃)	7.47	7.13	6.71	7.10
VOC conc. corrected to 15% O ₂ (dry)	2.81	2.69	2.43	2.65
VOC permit limit @ 15% O ₂ (ppmvd)	-	-	-	86

APPENDIX A

- IC Engine Sample Port Diagram

IC Engine Exhaust Stacks – 2 x 8" diameter

Stack Cross
Section

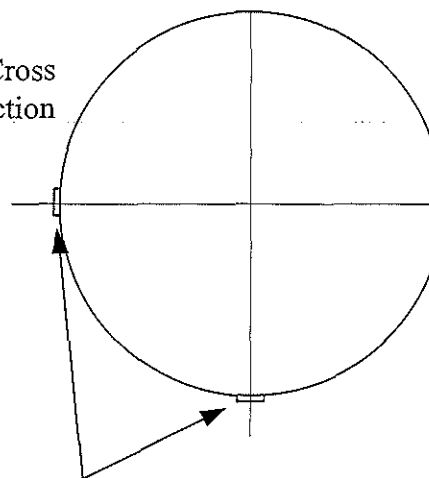

Sample
Ports

Temporary Stack
Extension

Sample Port

A = 14.25"

B = 44"

Cummins Model
GTA28
Generator Set

Engine Container

09/20/18	General Stack Diagram Cummins Emergency Generator Sets		
	Scale	Sheet	Derenzo Environmental Project 1808006
	None	1 of 1	

