


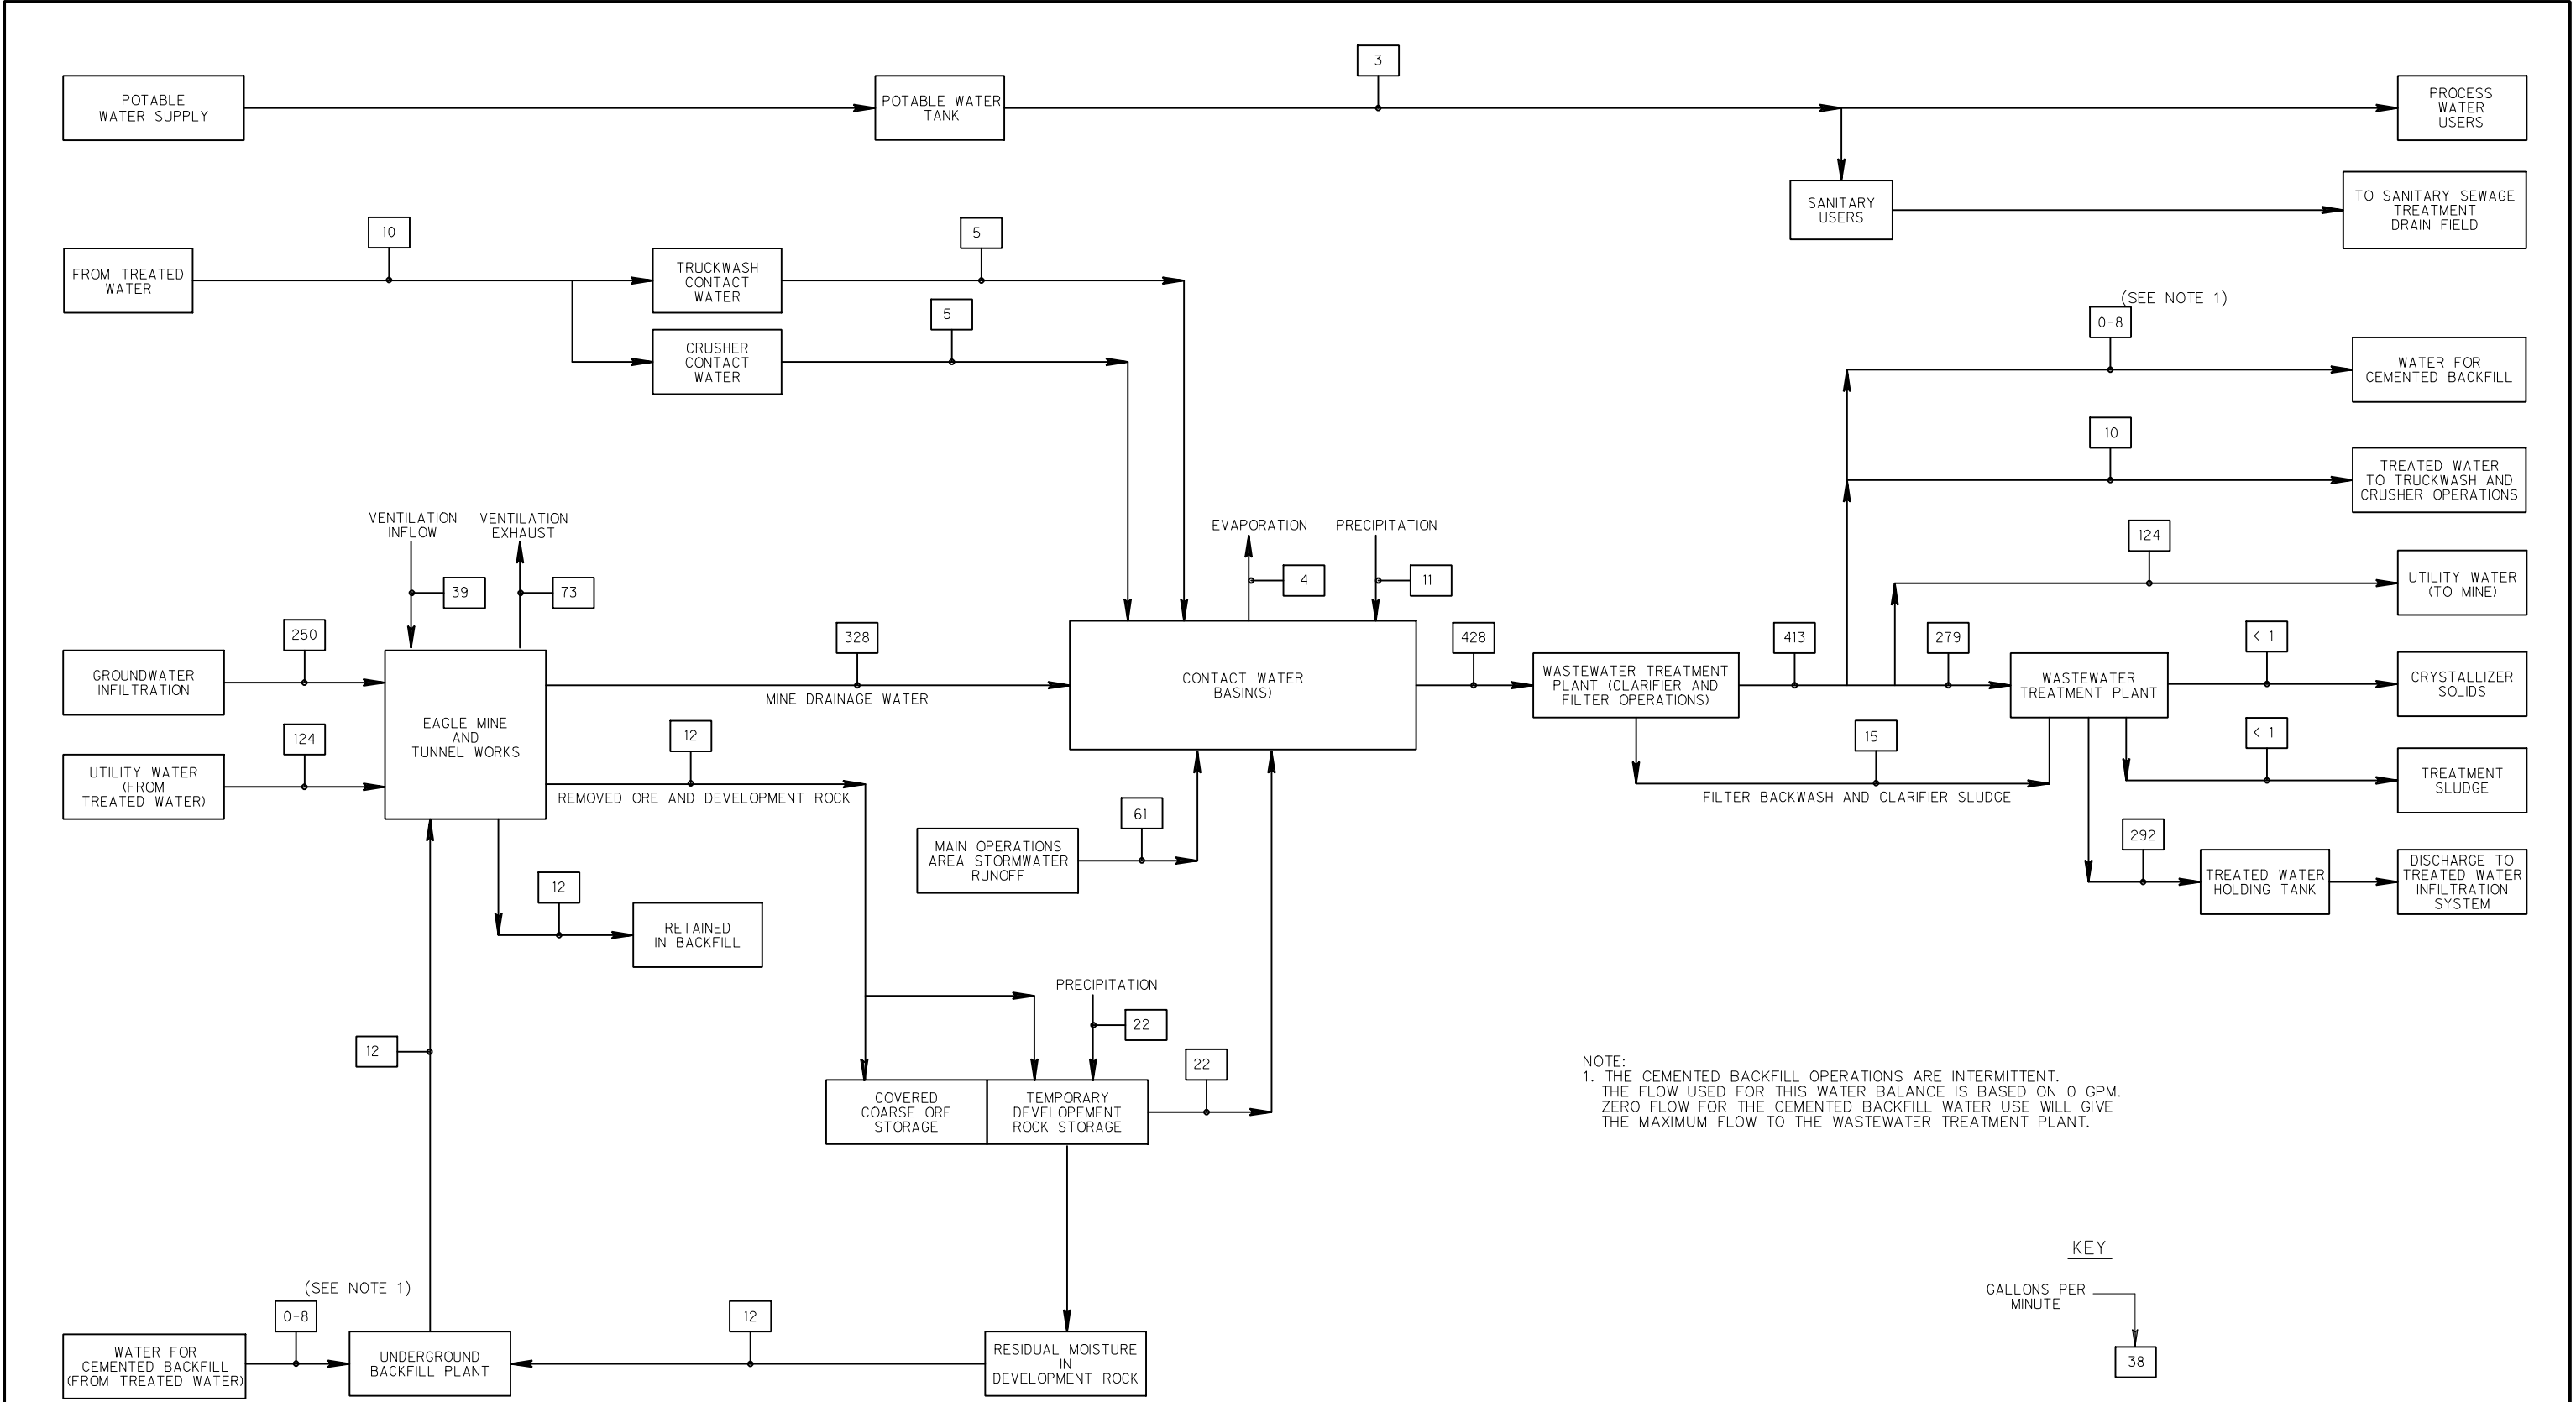

NOTE:
1. THE CEMENTED BACKFILL OPERATIONS ARE INTERMITTENT.
THE FLOW USED FOR THIS WATER BALANCE IS BASED ON 0 GPM.
ZERO FLOW FOR THE CEMENTED BACKFILL WATER USE WILL GIVE
THE MAXIMUM FLOW TO THE WASTEWATER TREATMENT PLANT.

Foth & Van Dyke						
REVISED	DATE	BY	DESCRIPTION	FIGURE 4-18A WATER BALANCE MAXIMUM ANNUAL PRECIPITATION AND MINE INFLOW		
CHECKED BY:		JJF1	DATE: FEB. '06	Scale:	NONE	Date: FEBRUARY, 2006
APPROVED BY:		SVD1	DATE: FEB. '06	Prepared By: Foth & Van Dyke By: GJB 04W018		
APPROVED BY:			DATE:			