
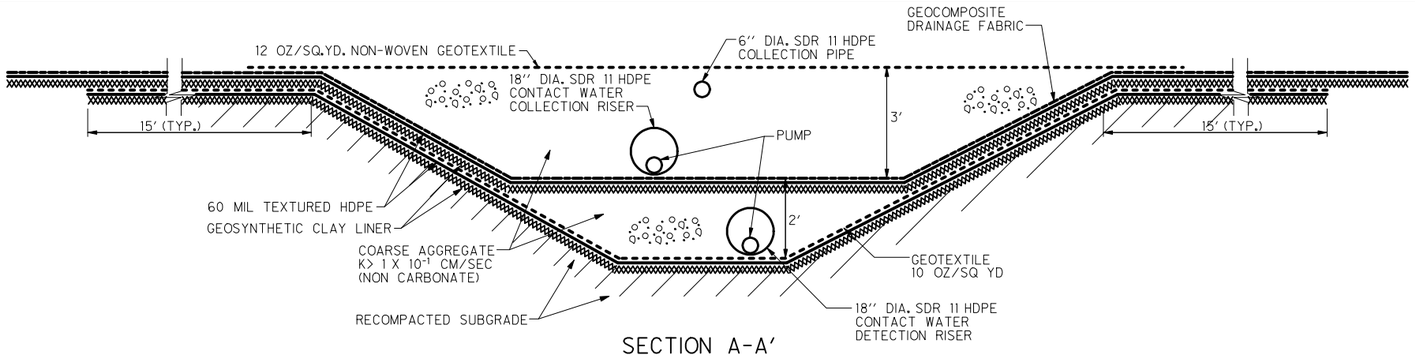



SECTION A-A'

NOT TO SCALE

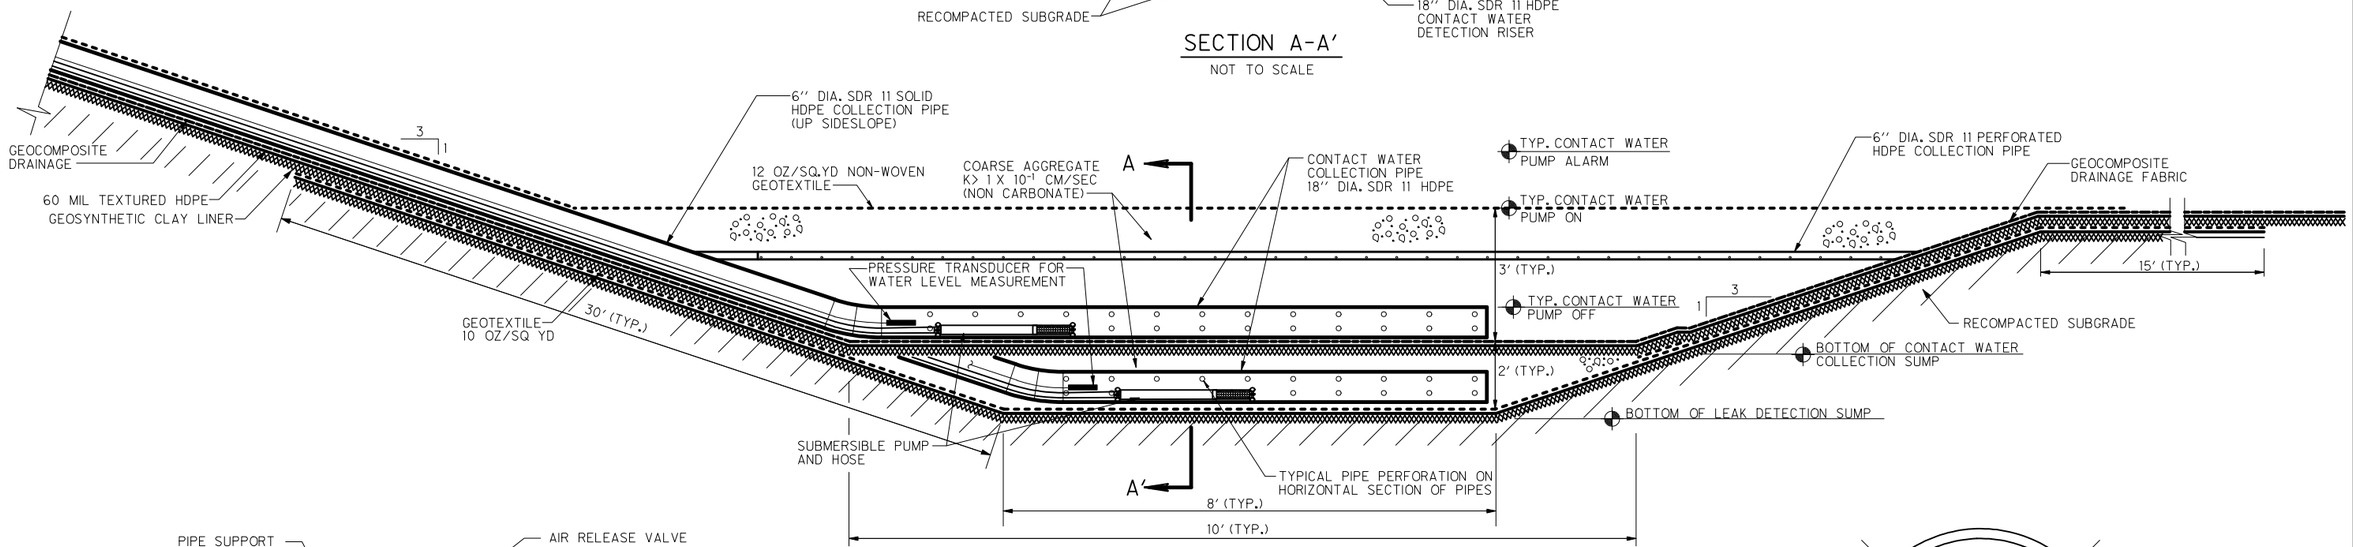

TYPICAL CONTACT WATER COLLECTION SUMP DETAIL


NOT TO SCALE

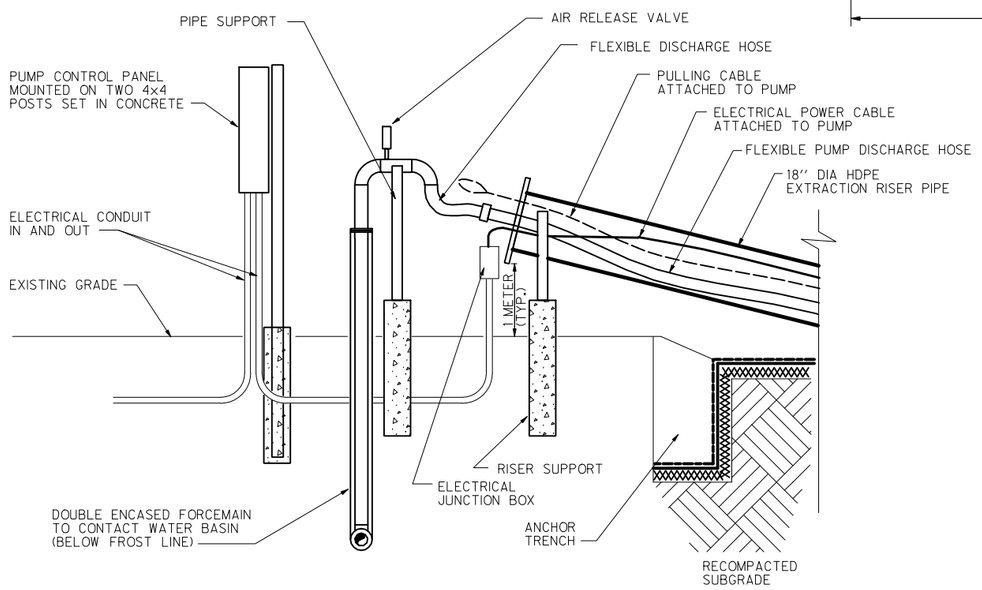

TYPICAL PUMP DISCHARGE DETAIL

NOT TO SCALE

NOTE: BASED UPON OPERATION NEEDS THE CONTROL PANEL AND DISCHARGE PIPING MAY BE HOUSED WITHIN A TEMPORARY BUILDING.

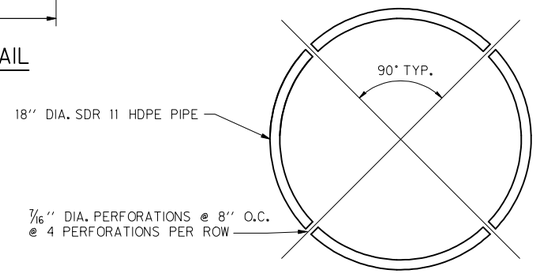

TYPICAL CONTACT WATER COLLECTION RISER PERFORATION DETAIL

NOT TO SCALE

Foth & Van Dyke				
REVISED	DATE	BY	DESCRIPTION	
CHECKED BY:	JOS1		DATE: FEB. '06	
APPROVED BY:	SVD1		DATE: FEB. '06	
APPROVED BY:			DATE:	

Kennecott Eagle Minerals

FIGURE 5-6

TDRSA CONTACT WATER COLLECTION SUMP AND LEAK DETECTION SYSTEM

Scale: NOT TO SCALE	Date: FEBRUARY, 2006	
Prepared By: **Foth & Van Dyke**	By: JOW	04W018

I:\04w018\MPA\4w18fig6-4tdrsasumplkdetc.dgn
2/17/2006 jow